

# ZUCCHINI XCP BUSBAR

FOR POWER  
DISTRIBUTION SYSTEMS



# Global strength built on local knowledge

Legrand is the global specialist in electrical and digital building infrastructures. Innovation is the driving force behind its development.

With an increasing investment in research and development (circa 5% of sales) and more than 4,000 active patents, the Legrand Group is focused on maintaining a high rate of new product launches that present innovative solutions to the market.


## CORPORATE SOCIAL RESPONSIBILITY

Legrand's CSR roadmap is a natural extension to the governance and sustainable development approach in which the company has been engaged for many years. The CSR roadmap firmly asserts Legrand's ongoing commitment to sustainable development.



## LEGRAND'S POWER DISTRIBUTION BUSINESS UNIT

From Legrand transformers, through high power distribution and rising main busbar to Electrak powertrack, desk modules and lighting control, Legrand's power distribution business unit provides market leading solutions to the increasing demands of today's buildings.

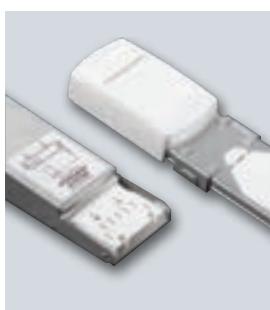



LEGRAND ENERGY EFFICIENCY

Legrand has long been committed to an initiative to protect the environment.

We are dedicated to ensuring that everyone can use electricity in a sustainable way. By working together we can create solutions that deliver less carbon to the environment.

Look out for the green leaf which identifies our range of energy efficient busbars.



## XCP OVERVIEW

Safety, flexibility and simplicity	04
Range features	06
XCP-S and XCP-HP	07
Range composition	09
Product additional features	10
GRP and metal tap-off boxes	11

## SELECTION GUIDE

Busbar selection guide	13
XCP-S - technical information	20
XCP-HP - technical information	28
Design instructions for the creation of a rising mains [BTS*]	36

## OPERATING INFORMATION

Suggestions for the design and installation of the busbar	38
Protection classifications	47


\*BTS = busway trunking system

CATAI OGUJ

XCP

3

# XCP IP 55 busbar trunking

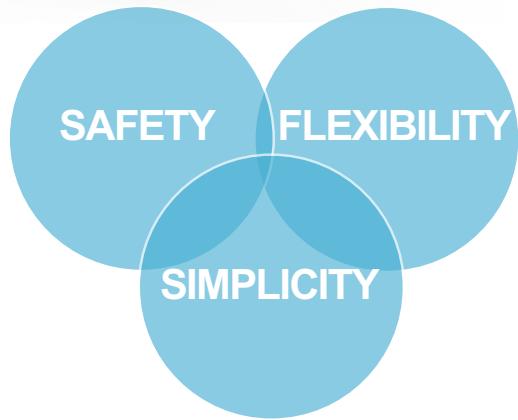

**XCP** is the new Zucchini busbar trunking system ranging from 630 A to 6300 A with an IP 55\* degree of protection.

It is the most suitable solution for the transport and distribution of energy in industrial, commercial and service sector installations. The main benefits of the range are SAFETY, FLEXIBILITY and SIMPLICITY.

## CERTIFICATION AND TESTING

The busbar trunking has been tested and approved according to IEC 61439-6 Low voltage switchgear and controlgear assemblies. Part 6 refers to busbar trunking systems (busways).



## Typical applications

- Industry
- Riser end feed units
- Commercial and service sector buildings (banks, hospitals, data centres, business centres)



# Safety

## Fire resistance

In installations where there is a high risk of fire, the XCP busbar trunking system can provide technical advantages. Thanks to the low fire load of the busbar, XCP has been fire resistance tested in accordance with IEC 60331-1.



## Insulation technology

In order to achieve superior quality and safety, XCP conductor bars are wrapped by two PET sheets, each of which is individually sufficient to ensure the full required dielectric level. PET is a non-hygroscopic thermoplastic polymer resin and therefore preserves its performance whatever the level of humidity. For more information on the material characteristics see page 45.

## Maximum strength

The XCP range has been designed and manufactured for heavy industrial environments.

The busbar is self-contained within its own casing, with the degree of impact resistance being IK 10 which is the maximum stated in IEC EN 60068-2-62.



# Flexibility

By using the outlet windows located on the straight lengths of the busbar, XCP provides high flexibility, both when planning and installing the system. It is ideal for frequently changing requirements of the electric system during the life of the building.

The XCP range provides all the necessary components needed for the installation of rising mains.

This is an excellent solution for all high-rise buildings such as residential or commercial blocks, hospitals and office blocks which have power distribution on every floor.



## Electromagnetic emission

The ferromagnetic structure of the casing, and the compactness of the bars, significantly reduce the electromagnetic field emitted. The magnetic induction, measured at 1 m from the XCP busbar, is much lower than 3 $\mu$ T which typically represents the quality objective of several countries.

## Sprinkler proof

**It is possible to accessorise XCP with a sprinkler kit that provides resistance to the sprinkler test. The sprinkler kit is available on request.**

Tests under sprinkler conditions are available. For more information please contact us on +44 (0) 370 608 9020



SPRINKLER KIT

## Resistance to seismic events


All busbar systems and their supports are laboratory tested and guarantee (if the product is installed in accordance with the manufacturer's instructions) resistance to seismic events in the local territory.

The XCP-S and XCP-HP ranges and related tap-off boxes, have passed seismic tests at a value of ZPA 1.5g \* in accordance with IEEE Std 693-2018. Considering that : ZPA 1.5g = 1.5 x 9.81 m/s<sup>2</sup> = 14.71 m/s<sup>2</sup>. The maximum acceleration value obtained corresponds to extremely intense earthquakes.

# Simplicity

With **XCP**, the design and installation of the power distribution line becomes quick and simple.

In order to facilitate and reduce the installation time, the elements are supplied with a monobloc which is pre-installed at the factory and the connections between them are keyed, which ensures that the installation of the components is in the correct position.

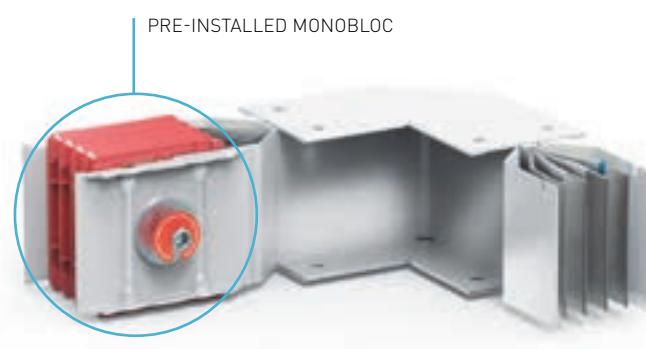

# RANGE features

## Xtra-compact design

**XCP** is available with aluminium or copper conductors and has a smart and extra-compact design.


The external dimensions do not change based on the number of conductors. The length and height change with the rating, but are the same for all three combinations of conductors available (3 / 4 / 5 conductors).





Often, for the transport and distribution of high power (5000 A Al / 6300 A Cu rated current), the energy distribution consists of two independent busbars in parallel.

**With XCP multi-bar, the product is always supplied in a single structure** so it is simpler to install compared to independent busbar designs.

This also ensures that the system has been fully tested to achieve the desired rating rather than relying on the individual rating of each independent busbar.

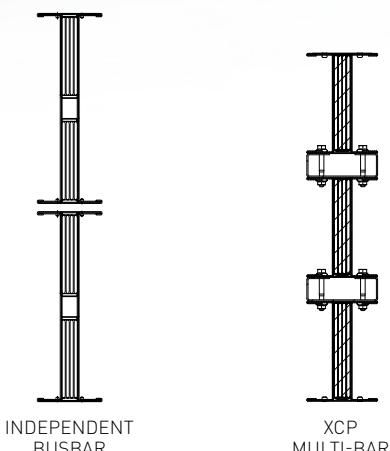

**XCP is available in aluminium versions (630 - 5000 A) or with copper conductors (800 - 6300 A)**

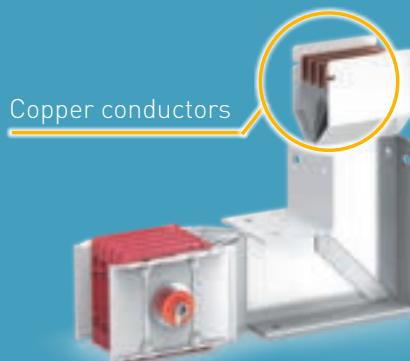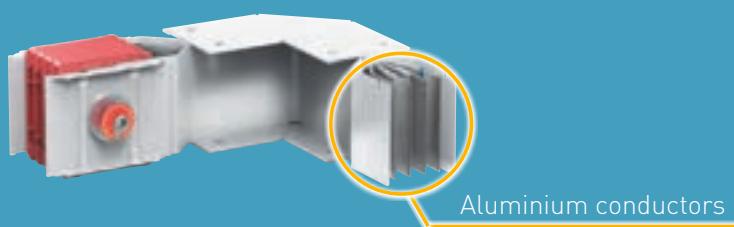

# XCP-S and XCP-HP



The XCP range of busbars consists of two different product lines :

- **XCP-S**
- **XCP-HP**

While maintaining the same basic characteristics (such as the range of rated current, the construction materials and the accessories available), XCP-S and XCP-HP have different properties that make them able to satisfy all market sector demands.

**XCP-S** is the optimised solution for the most common performance requirements.

The optimised sections of internal conductors allow this busbar to be lighter and more compact than XCP-HP, making it the best choice for standard applications.

**LIGHTER**

**SMALLER**

**FOR STANDARD APPLICATIONS**

**XCP-HP** is the busbar system designed to offer a higher performance in terms of energy saving and short circuit withstand. It is designed to work at an ambient temperature of 50°C.

Thanks to these features, XCP-HP is the ideal solution for heavy duty applications, higher temperature environments and installations where high energy efficiency is required.

**HIGHER PERFORMANCE**

**FOR HEAVY DUTY APPLICATIONS**

NUMBER OF INTERNAL BARS OF XCP-S AND XCP-HP

RATED CURRENT	630 A	800 A	1000 A	1250 A	1600 A	2000 A	2500 A	3200 A	4000 A	5000 A	6300 A
XCP-S ALUMINIUM	<b>SINGLE BAR configuration</b>						<b>DOUBLE BAR configuration</b>			*	
XCP-S COPPER	<b>SINGLE BAR configuration</b>						<b>DOUBLE BAR configuration</b>			*	
RATED CURRENT	630 A	800 A	1000 A	1250 A	1600 A	2000 A	2500 A	3200 A	4000 A	5000 A	6300 A
XCP-HP ALUMINIUM	<b>SINGLE BAR configuration</b>						<b>DOUBLE BAR configuration</b>			*	
XCP-HP COPPER	<b>SINGLE BAR configuration</b>						<b>DOUBLE BAR configuration</b>			*	

\* Triple bar


# XCP-S and XCP-HP



## Energy saving (Total cost of ownership)

The two busbar ranges, XCP-S and XCP-HP, also differ in loss values due to the Joule effect. XCP-HP has lower Joule losses compared to XCP-S and this feature means that, in a relatively short time, it will be possible to recover the additional cost invested in the purchase of a low loss busbar system compared to the cost of a standard loss busbar system.

In the graph below you can see an indicative example of the possible economic savings in relation to the loss values of the busbar system.

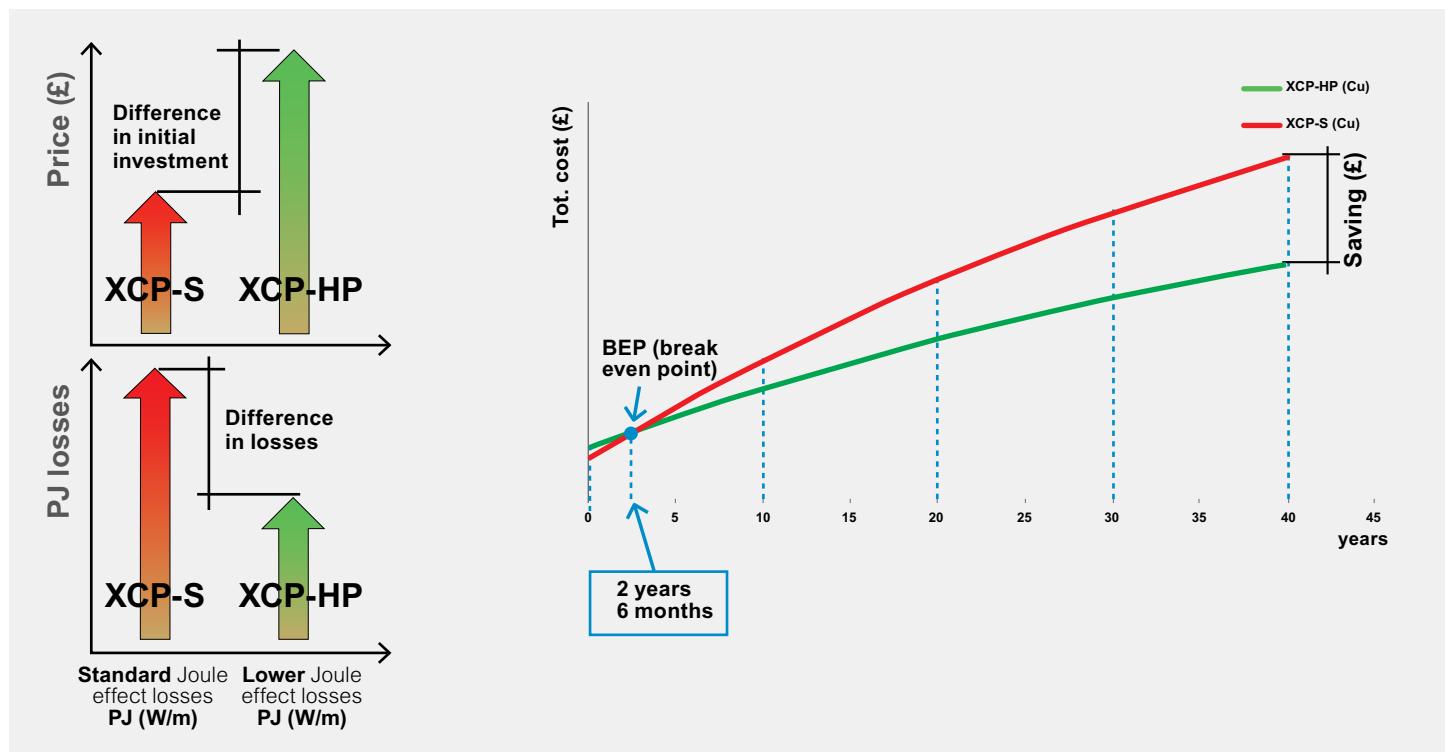

**Note :** The time required to reach the break even point changes depending on energy costs in the country in which the analysis is conducted.


TOTAL COST OF OWNERSHIP = PURCHASE COST + OPERATING COST OF THE BUSBAR

**XCP can be connected to RCP resin busbar thanks to an adapter element.**

This solution allows XCP to be used in hybrid systems where different degrees of protection are required.

It is possible to transition from the inside to the outside of a building by connecting the IP 55 XCP busbar trunking with IP 68 RCP resin busbar trunking using the adapter element.

**ADAPTER ELEMENT (IP 55/65 TO IP 68)**

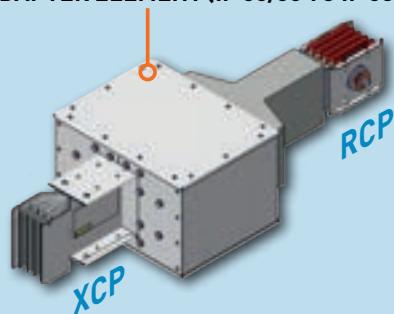

# RANGE composition

The **XCP** range includes all the necessary components to enable any path for the busbar run that the project requires.

## The range is composed of :

### STRAIGHT LENGTHS :

for transport and distribution (with tap-off outlets) of high-power energy

### ELBOWS :

able to meet any change of direction and orientation with standard or bespoke dimensions

### TAP-OFF BOXES :

for connecting and energising electric loads.  
Available in plug-in and bolt-on versions

### CONNECTION INTERFACES :


for connecting the busbar to the electric board or transformer

### ADDITIONAL COMPONENTS :

able to meet any installation requirement (fire barrier, phase inversion...)

### FIXING SUPPORTS :

for fixing the busbar to the structure of the building, for horizontal and vertical installations and special applications (seismic areas)

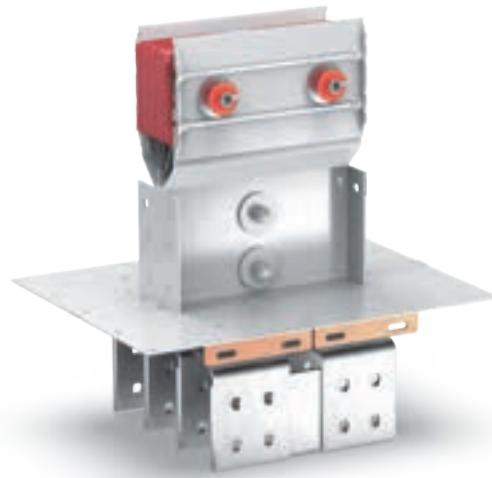

STRAIGHT LENGTHS WITH TAP OFF OUTLETS FOR DISTRIBUTION



HORIZONTAL ELBOW WITH DOUBLE BAR



VERTICAL ELBOW WITH DOUBLE BAR



CONNECTION INTERFACES



PLASTIC TAP-OFF BOXES PLUG-IN TYPE

**DIFFERENT VARIATIONS ARE AVAILABLE ON REQUEST. SEE EXAMPLES BELOW.  
FOR MORE INFORMATION PLEASE CONTACT US ON +44 (0) 370 608 9020.**

Reference	Version description
<b>64280102P</b>	standard 4 conductors (3Ph + N + PE casing)
<b>64280102P-R5</b>	4 conductors RAL painted on request
<b>64240102P</b>	5 conductors (3Ph + N + FE + PE casing)
<b>64250102P</b>	double neutral
<b>64280102P-3W</b>	3 conductors (3Ph + PE casing)
<b>64280102PF</b>	Class F insulation (155 °C)
<b>64280102P-RL</b>	PEN conductor
<b>64280102P-R3</b>	with aluminum extra-ground (reinforced PE) (PE3)
<b>64280102P-R4</b>	with copper extra-ground (reinforced PE) (PE2)

### Conductor versions

4 conductors + PE casing : with full neutral  
4 conductors + PE casing : with double neutral with respect to the phase section for applications with high values of third order harmonics (THD%)  
5 conductors + PE casing : 3 phases + full neutral + FE functional earth + PE

### Versions of PE:

PE1 : with casing used as earth conductor (standard)  
PE2 : with additional earth in copper plate  
PE3 : with additional earth in aluminium plate

# PRODUCT additional features

## End feed unit for rising mains

Feed units are used at the start of riser mains lines, when the busbar must be placed against the wall and powered using cables.

These feed units allow the product to be installed at a minimum distance of 40 mm from the wall.



## New monobloc

XCP is equipped with a new monobloc covered by a Legrand patent. This new monobloc ensures a better connection of the junction with less contact resistance.


The insulation part of the monobloc is made by thermo-set Class F (155°C) insulation material and for each conductor there are two plates that assure the continuity between each conductor. A system of Belleville® washers ensure the correct pressure during thermal expansion of the conductors. A double head nut breaks when it reaches the nominal torque (85 Nm). In the double/triple configurations, the monobloc ensures the current balancing on the same conductors.



DOUBLE HEAD NUT THAT BREAKS  
AT NOMINAL TORQUE (85 Nm)  
DURING 1st INSTALLATION

## SmartBolts®

SmartBolts® are available on request. These bolts are equipped with a visual indication system that turns from red to black when you reach the right tightening torque (85 Nm). They are also useful after installation and during checks and maintenance operations as they allow you to see at a glance if a bolt has lost the right torque by turning back to red.

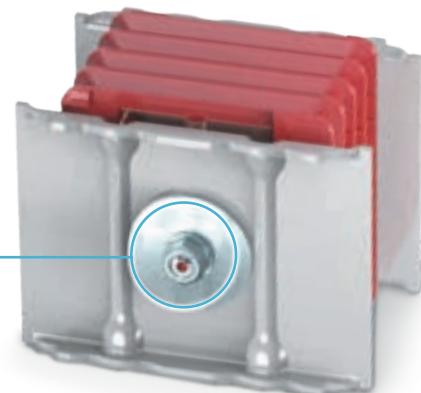

DTI (Direct Tension Indicating) SmartBolts® are fasteners with a built-in indicator that shows the tension has been achieved when the bolt is installed.

# TAP-OFF BOXES

## GRP\* and metal

XCP distribution bars are equipped with outlets suitable for the **range of dedicated tap-off boxes**.

The tap-off boxes are available in two different construction materials:

- GRP\* composite with rating up to 250 A, plug-in type (to be installed on outlets)
- painted steel enclosure with rating up to 630 A for plug-in type (to be installed on outlets) and up to 1250 A for bolt-on type (to be installed on the junction)

They are **universal** and therefore **can be used on both (XCP-S and XCP-HP) product lines**.

### The new tap-off boxes guarantee:

- Safety
- Optimised dimensions
- Reduced maintenance costs
- Pre-fitted for MCB/MCCB circuit breakers



The design of the outlets enables the installation of GRP\* tap-off boxes in addition to the painted steel version.

**The degree of protection of the outlets and the system is IP 2x with the cover open and IP 55 with the cover closed or with tap-off unit installed.**

\* GRP = glass reinforced plastic

Tap-off boxes for XCP are available in two different materials: **GRP\*** and **metal**, both characterised by a simple installation and fast connection thanks to the new layout of hooks that offer safety and speed of assembly.

## GRP\* version:

- Range from 32 A to 250 A
- Optimised installation of Legrand circuit breakers (MCB/MCCB)
- Optimised for P17 Tempra Pro CEE sockets
- Ready for data centre applications
- Empty or with fuse carrier version available
- Total insulation
- Plug-in / plug-out under live voltage



GRP VERSION FROM 32 A TO 250 A

## Painted steel version:

- Range from 63 A to 630 A
- Optimised installation of Legrand circuit breakers (MCCB)
- Optimised for P17 Tempra Pro CEE sockets
- Ready for data centre applications
- Empty or with fuse carrier version available
- Equipped with :
  - anti-manoeuvre security system
  - anti-accidental closing and opening of the box
  - guard for open covering
  - safer vertical installation (the cover remains in an open position)
- Plug-in / plug-out under live voltage



PAINTED STEEL VERSION FROM 63 A TO 630 A

\*GRP = glass reinforced plastic



Other devices available on request  
Contact us on +44 (0) 370 608 9020

## Tap-off boxes: accessories

Tap-off boxes are ready to be assembled with Legrand circuit breakers and industrial sockets\*\*




DPX<sup>3</sup> DIN MODULES



P17 SOCKETS

\*\* Accessories not supplied. To be purchased separately.

# SELECTION GUIDE

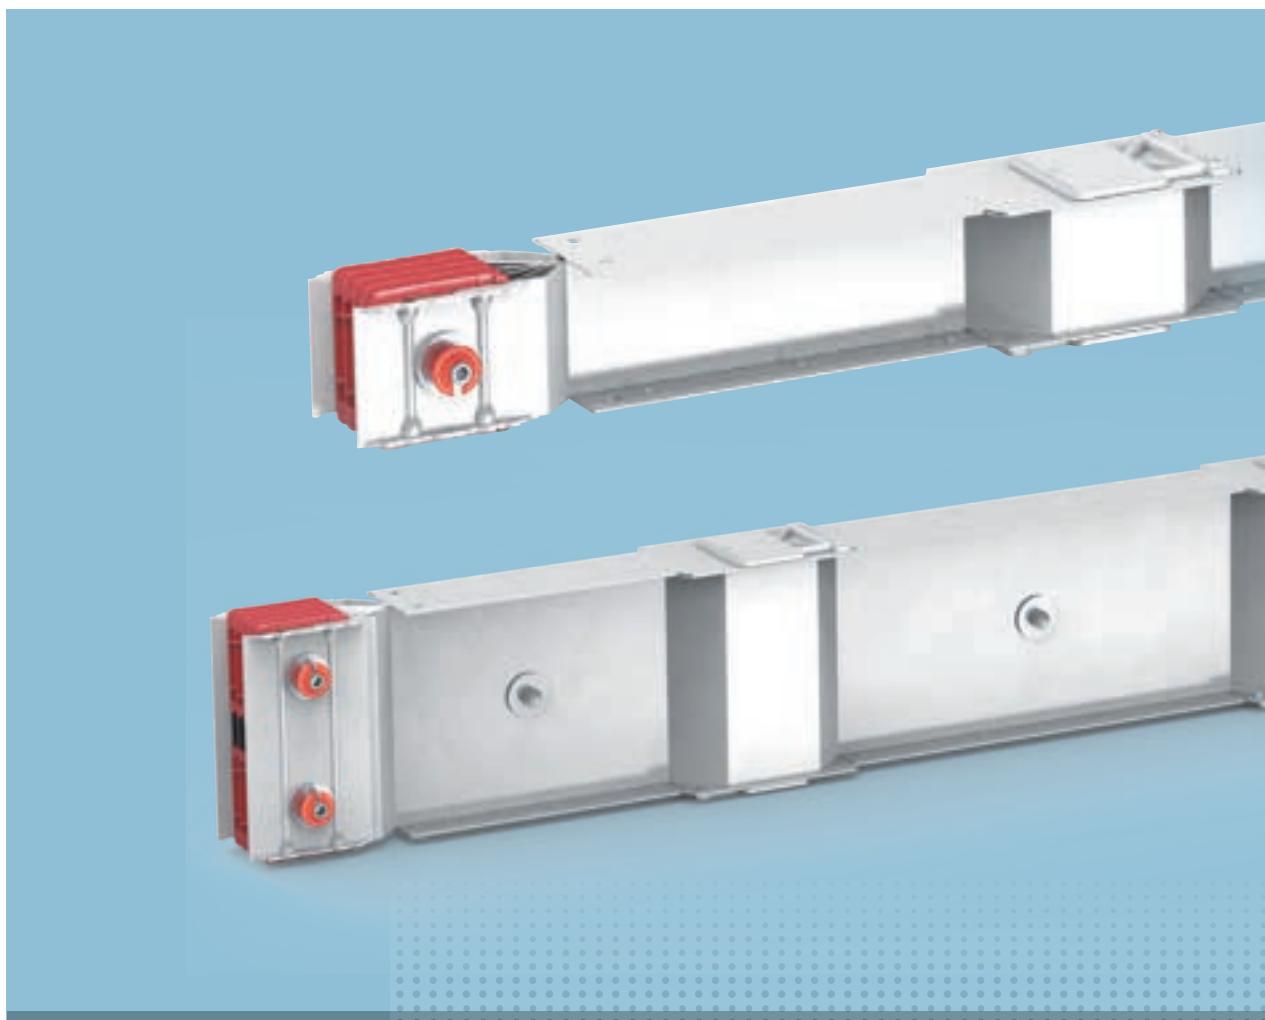

## CONTENTS

- 14 Busbar selection based on the rated transformer data
- 14 Temperature impact on the rating of the busbar trunking system
- 15 Joule effect losses in busbar
- 16 Busbar trunking system selection based on voltage drop
- 17 Short circuit withstand
- 17 Characterisation of short circuit current
- 19 Harmonics

## technical information

### Selection of the busbar based on the rated transformer data

During the design stage of the power supply system, it is necessary to consider all the technical specifications and standards for the equipment selected. The designer not only needs to specify the technical requirements but the economical performance of the system. Each element of the electrical system (transformer, switchboards, protection devices and busbar) should be sized accordingly to support the peak loads and the short circuit current in the event of a fault. The table below shows popular transformer ratings with their rated current and their peak short circuit current.

RATED CURRENTS AND SHORT CIRCUIT CURRENTS OF STANDARD TRANSFORMERS						
Rated power [kVA]	Rated voltage Un					
	400 V, 50 Hz		690 V, 50 Hz			
	Rated short circuit voltage $U_k$		Rated short circuit voltage $U_k$			
	4%	6%	4%	6%		
400	577	14.4	9.6	335	8.4	5.6
500	722	18.0	12.0	418	10.5	7.0
630	909	22.7	15.2	527	13.2	8.8
800	1155	28.9	19.2	669	16.7	11.2
1000	1443	36.1	24.1	837	20.9	13.9
1250	1804	45.1	30.1	1046	26.1	17.4
1600	2309	57.7	38.5	1339	33.5	22.3
2000	2887	72.2	48.1	1673	41.8	27.9
2500	3608	90.2	60.1	2092	52.3	34.9
3150	4547	113.7	75.8	2636	65.9	43.9
4000	5774	144.3	96.2	3347	83.7	55.8

$$I_n = \frac{P}{\sqrt{3} \cdot U_n} \leftrightarrow P = I_n \cdot \sqrt{3} \cdot U_n \quad I_k = \frac{I_n}{U_k} \leftrightarrow I_n \cdot I_k = I_k \cdot U_n$$

Using the above table, a designer can cross reference their load requirements and select a busbar trunking system suited to their design.

The first selection criteria for the appropriate busbar is based on the transformers rated current ( $I_n$ ). The busbar rating should exceed the transformers rated current. The second selection criteria is based upon the short circuit current. The designer should select a busbar rating that exceeds the  $I_k$  when compared to the busbar's peak current ( $I_{pk}$ ). Note: The above applies to standalone transformers. For transformers in parallel, ring or mesh networks, the short circuit current ( $I_k$ ) will increase (i.e for transformers in parallel the  $I_k$  would be double).

#### Selection example:

Using the following transformer :

$$\begin{aligned} P &= 1000 \text{ kVA} \\ U_k &= 6\% \\ U_n &= 400 \text{ V} \end{aligned}$$

and the calculation and table above,

$$I_n = \frac{P}{\sqrt{3} \cdot U_n} \rightarrow I_n = \frac{1000000}{\sqrt{3} \cdot 400} = 1443 \text{ A} ;$$

$$I_k = \frac{I_n}{U_k} \rightarrow I_k = \frac{1443}{6\% \cdot 1000} = 24,05 \text{ kA}$$

The choices are :

- XCP-S (50 Hz, Al, 4C) having  $I_n=1600 \text{ A}$  and short-circuit rating  $I_{cw} = 42 \text{ kA}$
- XCP-HP (50 Hz, Al, 4C) having  $I_n=1600 \text{ A}$  and short circuit rating  $I_{cw} = 70 \text{ kA}$

**To select other system trunking paths (not just the main units at the transformer output), you need to consider and calculate the parameters on the following pages**

### Temperature impact on the rating of the busbar system

The ambient temperature where the busbar trunking system is installed impacts on its rating. During the design stages, it will be necessary to multiply the rating value at the reference temperature by a correction coefficient referred to the final operating temperature.

All Legrand products have been sized and tested for an average ambient temperature specific for each line. For installation in environments with different average daily temperatures, the rated current of the busbar must be multiplied by a  $k_t$  factor, which gives the correct value to consider.

$$I_z = I_{z0} \cdot K_t$$

Where:

- $I_{z0}$  is the current that the busbar trunking system can carry for an indefinite time at its reference temperature
- $K_t$  is the correction coefficient for ambient temperature values other than the reference temperature, as shown in the following table

#### KT CORRECTION COEFFICIENT FOR AMBIENT TEMPERATURE

##### XCP-S

Ambient temperature [ $^{\circ}\text{C}$ ]

-5	0	5	10	15	20	25	30	35	40	45	50
1.24	1.21	1.18	1.15	1.12	1.09	1.06	1.03	1	0.97	0.93	0.90

$k_t$  thermal correction factor

##### XCP-HP (Al)

Ambient temperature [ $^{\circ}\text{C}$ ]

-5	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70
1.38	1.34	1.31	1.28	1.25	1.21	1.18	1.15	1.11	1.07	1.04	1	0.96	0.92	0.88	0.84

$k_t$  thermal correction factor

##### XCP-HP (Cu)

Ambient temperature [ $^{\circ}\text{C}$ ]

-5	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70
1.43	1.40	1.37	1.33	1.30	1.26	1.23	1.19	1.16	1.12	1.08	1.04	1	0.96	0.92	0.87

$k_t$  thermal correction factor

## technical information

### Joule effect losses in busbar

Losses due to the Joule effect are caused by the electrical resistance of the busbar.  
Lost energy is transformed into heat and contributes to the heating of the conduit within the environment.  
The calculation of power loss is required to allow the correct sizing of the building air conditioning system.

- Three phase regime losses are :

$$P_j = \frac{3 \cdot R_t \cdot I_b^2 \cdot L}{1000}$$

- In single phase regime :

$$P_j = \frac{2 \cdot R_t \cdot I_b^2 \cdot L}{1000}$$

- Where :

$I_b$  = utilisation current (A)


$R_t$  = phase resistance for unit of length of the busbar trunking system, measured at thermal regime ( $\text{m}\Omega/\text{m}$ )

$L$  = busbar length (m)

For an accurate calculation of distribution busbar, losses must be assessed based on the distribution load, taking into account the reduction in current, for example, in the case of the distribution of the loads represented in the table below


Length	Transiting current	Losses
1st tap-off point	$L_1$	$P_1 = 3R_t L_1 (I_1+I_2+I_3)^2$
2nd tap-off point	$L_2-L_1$	$P_2 = 3R_t (L_2-L_1) (I_2+I_3)^2$
3rd tap-off point	$L_3-L_2$	$P_3 = 3R_t (L_3-L_2) (I_3)^2$

**Total losses in the busbar trunking system  $P_t = P_1+P_2+P_3$**

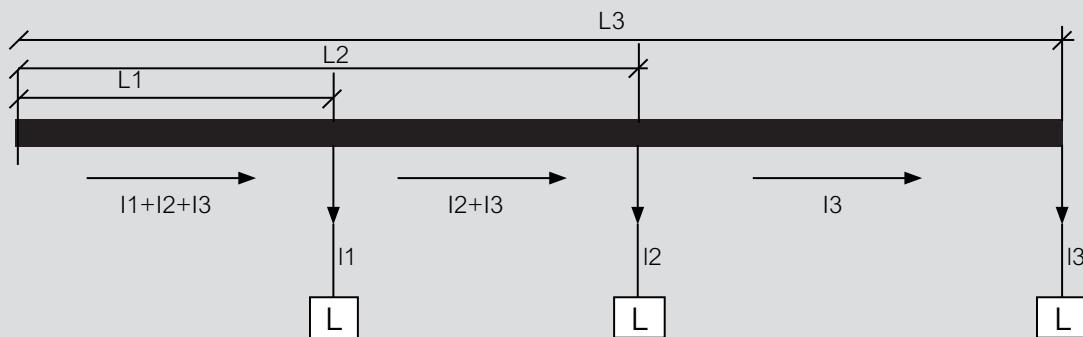


### Losses based on the installation method

Thermal dispersion, rating and IP protection degree are independent from the type of installation (edgeway, flat, vertical). This means that it is possible to install the XCP busbar trunking system as preferred, without having to consider a possible system downgrade.

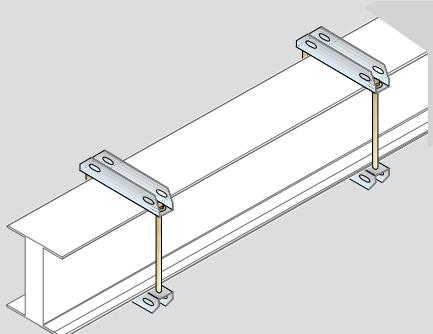

**Edgeway**

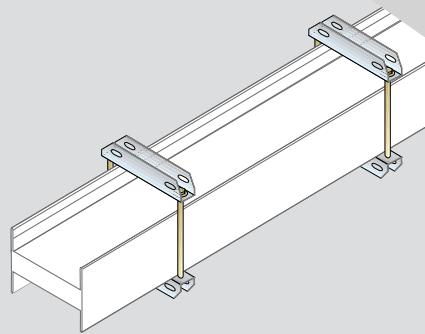

**Flat**

## Busbar trunking system selection based on voltage drop

It will be necessary to check the value of the voltage drop. For systems with power factor ( $\cos\varphi m$ ) no lower than 0.8, the voltage loss can be calculated using the following formulas :

### THREE PHASE SYSTEM

$$\Delta v = \frac{b \cdot \sqrt{3} \cdot I_b \cdot L \cdot (R_t \cdot \cos\varphi m + x \cdot \sin\varphi m)}{1000}$$

### SINGLE PHASE SYSTEM


$$\Delta v = \frac{b \cdot 2 \cdot I_b \cdot L \cdot (R_t \cdot \cos\varphi m + x \cdot \sin\varphi m)}{1000}$$

The percentage voltage drop can be obtained from :

$$\Delta v \% = \frac{\Delta v}{V_r} \cdot 100$$

Where  $V_r$  is the system rated voltage

In order to limit the voltage drop in case of very long busbar trunking systems, it is possible to allow for a power supply at an intermediate position, rather than at the terminal point

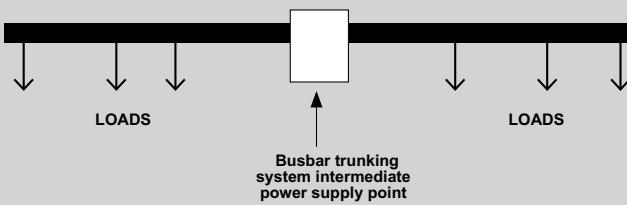

## Calculation of the voltage drop with loads not evenly distributed

In cases where the load cannot be considered evenly distributed, the voltage drop may be determined more accurately using the relationships shown below.

For the distribution of three phase loads, the voltage drop can be calculated using the following formula, on the assumption (generally verified) that the section of the busbar trunking system is consistent :


$$\Delta v = \sqrt{3} [R_t (I1L1 \cos\varphi 1 + I2L2 \cos\varphi 2 + I3L3 \cos\varphi 3) + x (I1L1 \sin\varphi 1 + I2L2 \sin\varphi 2 + I3L3 \sin\varphi 3)]$$

In general terms this becomes :

$$\Delta v = \frac{\sqrt{3} (R_t \cdot \sum i_i \cdot L_i \cdot \cos\varphi mi + x \cdot \sum i_i \cdot L_i \cdot \sin\varphi mi)}{1.000}$$

If the three phase system and the power factor are not lower than  $\cos\varphi = 0.7$ , the voltage loss may be calculated using the voltage drop coefficient shown in table 1

$$\Delta v \% = 2b \cdot \frac{k \cdot I_b \cdot L}{V_n} \cdot 100$$

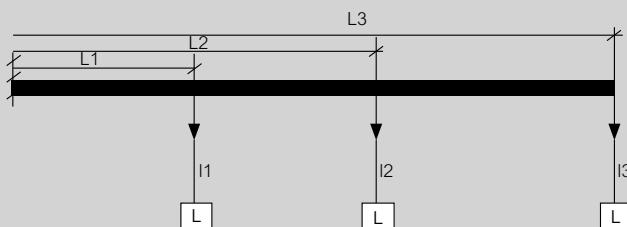

## Calculation of the voltage drop with loads not evenly distributed (continued)

The current distribution factor 'b' depends on how the circuit is fed and on the distribution of the electric loads along the busbar :

**Table 1 - The distribution factor of the current 'b'**

<b>b = 1</b>	Supplies at one end and load at the other end of the line	
<b>b = 1/2</b>	Supplies at one end and with load evenly distributed	
<b>b = 1/4</b>	Supplies at both ends and with load evenly distributed	
<b>b = 1/4</b>	Central supply with loads at both ends	
<b>b = 1/8</b>	Central supply with load distributed evenly	

**Example : XCP 2000 A AI for riser mains feed**

<b>I<sub>b</sub></b>	= 1600 A operating current
<b>b</b>	= 1/2 load evenly distributed
<b>k</b>	= 27.3 (XCP 2000 A AI cosφ = 0.85)
<b>cosφ</b>	= 0.85
<b>L</b>	= 100 m line length
<b>V<sub>n</sub></b>	= 400 V operating voltage

$$\Delta v \% = \frac{27.3 \cdot 10^6 \cdot 1600 \cdot 100}{400} \cdot 100 = 1.09\%$$

**Legend :**

<b>I<sub>b</sub></b>	= the current that supplies the busbar [A]
<b>V<sub>n</sub></b>	= the voltage power supply of the busbar [V]
<b>L</b>	= the length of the busbar [m]
<b>Δv %</b>	= the voltage drop percentage
<b>b</b>	= the distribution factor of the current
<b>k</b>	= corresponding voltage drop factor a cosφ [V/m/A]
<b>cosφ m</b>	= Average power factor of the loads
<b>x</b>	= phase reactance by unit of length of the busbar (mΩ/m)
<b>R<sub>t</sub></b>	= phase resistance by unit of length of the busbar (mΩ/m)
<b>cosφ mi</b>	= i-th load average power factor
<b>i<sub>i</sub></b>	= i-th load current (A)
<b>L<sub>i</sub></b>	= distance of the i-th load from the origin of the busbar trunking system

# technical information

## Short circuit withstand

The BS 7671 standard indicates that, for the protection of the circuits of the system, it is necessary to allow for devices aimed at interrupting short circuit currents before these become dangerous due to the thermal and mechanical effects generated in the conductors and the connections. In order to size the electric system and the protection devices correctly, it is necessary to know the value of the estimated short circuit current at the point where this is to be created. This value enables selection of the correct protection devices based on their own tripping and closing powers, and to check the resistance to electro-dynamic stress of the busbar supports installed in control panels, and/or of the busbar trunking system

## Characterisation of short circuit current

The estimated short circuit current at a point of the user system is the current that would occur if in the considered point a connection of negligible resistance was created between conductors under voltage. The magnitude of this current is an estimated value that represents the worst possible condition (null fault impedance, tripping time long enough to enable the current to reach the maximum theoretical values). In reality, the short circuit always occurs with significantly lower effective current values.

The intensity of the estimated short circuit current essentially depends on the following factors :

- Power of the cabin transformer, meaning that the higher the power, the higher the current
- length of the line upstream the fault, in the sense that the longer the line, the lower the fault

In three phase circuits with neutral it is possible to have three different types of short circuit :




- phase-phase
- phase-neutral
- balanced three phase (most demanding condition)

The formula for the calculation of the symmetric component is :

$$\overline{Icc} = \frac{\overline{E}}{\overline{ZE+ZL}}$$

Where :

- **E** is the phase voltage
- **ZE** is the secondary equivalent impedance of the transformer measured between the phase and the neutral
- **ZL** is the impedance of the phase conductor only

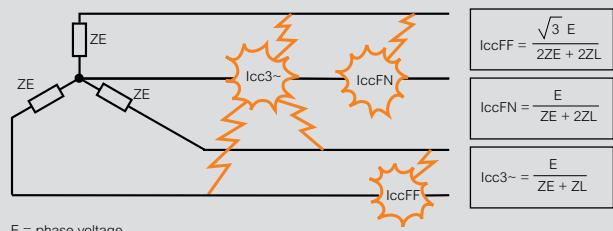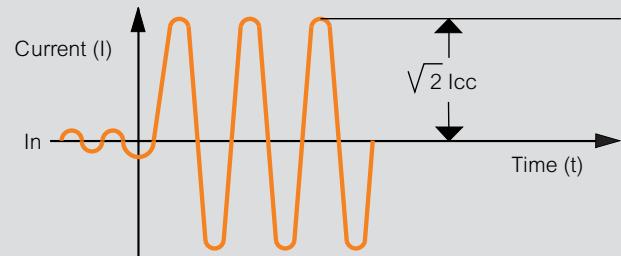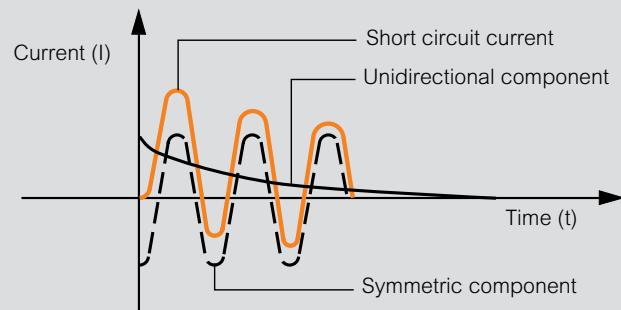


## technical information

### Analytical determination of short circuit currents

In order to calculate the value of the estimated short circuit current at any point of the circuit, it is sufficient to apply the formulas shown below, knowing the impedance calculated at the origin of the system up to the point being assessed

In the formulas shown below, the value of the short circuit power is considered infinite and the short circuit impedance is equal to 0. This makes it possible to define short circuit current values higher than the actual ones

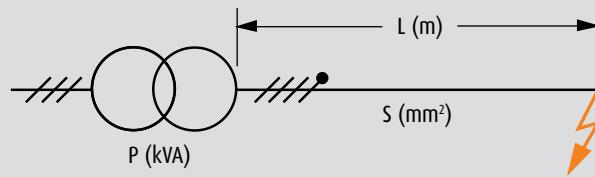

Line resistance  
 $RL = r \cdot L$

**RL** = resistance of the line upstream (m)  
**r** = specific line resistance (m/m)  
**L** = upstream line length (m)

Line reactance  
 $XL = x \cdot L$

**XL** = upstream line reactance (m)  
**x** = specific line reactance (m/m)

Transformer resistance

$$RE = \frac{1000 \cdot P_{cu}}{3In^2}$$

**RE** = transformer secondary equivalent resistance (m)  
**P<sub>cu</sub>** = transformer copper losses (W)  
**In** = transformer rated current (A)

Transformer impedance

$$ZE = \frac{Vcc\% \cdot Vc}{100 \cdot P}$$

**ZE** = transformer secondary equivalent impedance (m)  
**V<sub>c</sub>** = phase voltage (V)  
**Vcc%** = percentage short circuit voltage  
**P** = transformer power (kVA)

Transformer reactance

$$XE = \sqrt{ZE^2 - RE^2}$$

**XE** = transformer secondary equivalent reactance (m)

Short circuit impedance

$$Zcc = \sqrt{(RL + RE)^2 + (XL + XE)^2}$$

**Zcc** = total short circuit impedance (m)

Estimated short circuit current

$$Icc = \frac{Vcc}{\sqrt{3 \cdot Zcc}}$$

**Icc** = symmetric component of the short circuit current (kA)

#### XCP-S 4C (AL)

Rated current	In [A]	630	800	1000	1250	1600	2000	2500	3200	4000	5000
Rated short-time current (1 s)	Icw [kA]rms	25*	25*	36	42	42	50	65	80	100	120
Peak current	Ipk [kA]	53	53	76	88	88	105	143	176	220	264
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15*	15*	22	25	25	30	39	48	60	72
Peak current of the neutral bar	Ipk [kA]	30	30	46	53	53	63	82	101	132	158

#### XCP-S 4C (CU)

Rated current	In [A]	800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Rated short-time current (1 s)	Icw [kA]rms	25	36	42	42	50	65	80	100	120	150
Peak current	Ipk [kA]	53	78	88	88	105	143	176	220	264	330
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the neutral bar	Ipk [kA]	30	46	53	53	63	82	101	132	158	198

\* Icw value at 0.5 s.

#### XCP-HP 4C (AL)

Rated current	In [A]	630	800	1000	1250	1600	2000	2500	3200	4000	5000
Rated short-time current (1 s)	Icw [kA]rms	36	36	50	70	70	85	120	120	150	150
Peak current	Ipk [kA]	76	76	105	154	154	187	264	264	330	330
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the neutral bar	Ipk [kA]	45	45	63	88	88	112	158	158	198	198

#### XCP-HP 4C (CU)

Rated current	In [A]	800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Rated short-time current (1 s)	Icw [kA]rms	36	50	70	70	85	120	120	150	150	150
Peak current	Ipk [kA]	76	105	154	154	187	264	264	330	330	330
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the neutral bar	Ipk [kA]	45	63	88	88	112	158	158	198	198	198

## technical information

### Harmonics

In a distribution system, currents and voltages should have a perfectly sinusoidal shape. However, in practice the equipment contains electric devices such as changeover switches or dimmers that make the load not linear

The currents absorbed, although at regular intervals and with frequencies equal to that of the rated voltage, sometimes have a non-sinusoidal wave form, which has the following negative effects :

- worsening of the power factor
- heating of the neutral
- additional losses in electric machinery (transformers and motors)
- unstable operation of the protection elements (thermal magnetic and earth leakage circuit breakers)

In industrial buildings these conditions have been occurring for a long time. However, they are now occurring more and more in service sector distribution systems where, from backbone distribution (which uses three phase lines), single phase loads are often distributed, and which contributes to increasing the unbalance of the electric system

The overall waveform may contain multiple harmonic waveforms called harmonic components

A deformed current at a frequency of 50 Hz, like the example represented by the magenta line in the figure, consists of many sinusoidal currents with frequency of 50 Hz (fundamental), 100 Hz (second harmonic components), 150 Hz (third harmonics) and so on



The presence of current harmonics represents an important problem, causing overload conditions both on phase conductors, and on any neutral conductor, and results in the reduction of the conductor's permitted load

### Choice of the rating when in the presence of harmonics

When in the presence of harmonics, and when using the chosen Int rated current, the XCP busbar to be used has the rating specified in the table below

Rated current [A]	630	800	1000	1250	1600	2000	2500	3200	4000	5000	6300
XCP busbar to be used :											
THD ≤ 15%	630	800	1000	1250	1600	2000	2500	3200	4000	5000	6300
15% < THD ≤ 33%	800	1000	1250	1600	2000	2500	3200	4000	5000	6300	-
THD > 33%	1000	1250	1600	2000	2500	3200	4000	5000	6300	-	-

**Measurement of harmonic distortion carried out with a network analyser**

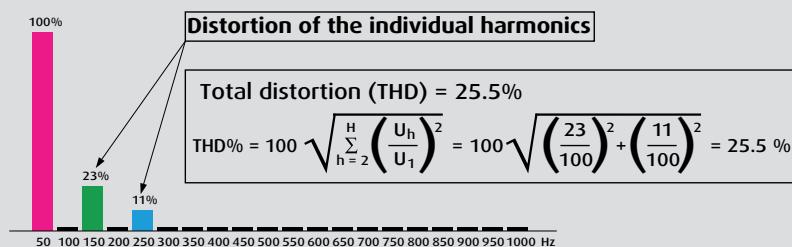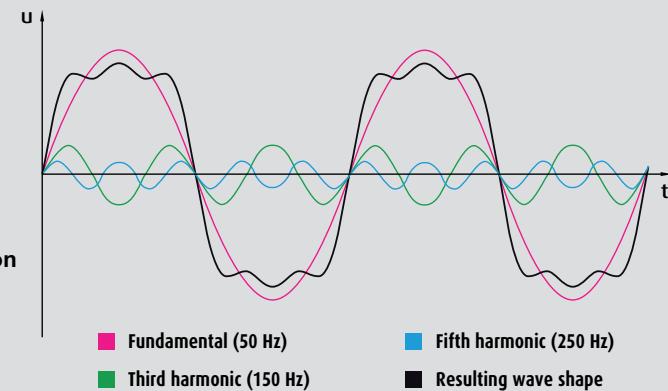

**Note :**

200% neutral versions are available for systems with harmonics present on the neutral



# XCP-S

Compact  
power solution,  
optimised for  
standard applications

## BUSBAR FROM 630 TO 6300 A

**XCP-S** is an extra compact and light busbar trunking system. It is the range used for transport and distribution of high power, including rising mains. Applications include all industrial, commercial and service sector buildings such as factories, banks, trade and business centres, hospitals and data centres etc.

# Xtra Compact (XCP-S)

## technical information

### General features

XCP-S is available in the following configurations :  
**from 630 A to 5000 A with aluminum alloy conductors**  
**and from 800 A to 6300 A with copper conductors**

The extra compact dimensions of the XCP-S enhance its resistance to short circuit stresses. In addition, they can reduce the impedance of the circuit by controlling the voltage drops and allowing for the installation of high power electrical systems, even in extremely confined spaces

XCP-S is available with a wide selection of tap-off boxes that range from 32 A up to 1250 A, thus allowing you to locally protect and feed different types of loads by housing protective devices such as fuses, MCBs, MCCBs and motorised switches

XCP-S is not only in compliance with the harmonised standards, IEC EN 61439-6, but also answers specifically to many clients' needs for more severe conditions

Thus the rated current of Legrand's busbar trunking systems is referred to the average ambient temperature of 35 °C

The nominal range of all XCP-S is guaranteed both for horizontal installations (flat and edgeways) and for vertical installations without derating

XCP-S busbar trunking systems are designed so that they can be relatively maintenance-free, except for the periodic and compulsory inspections required by the standard BS 7671

The tightening torque inspection of the junction can be carried out by qualified personnel, even when the busbar is energised

### Structural features

The outer casing of the XCP-S line consists of four C-ribbed section bars, bordered and riveted (thickness 1.5 mm), with excellent mechanical, electric and heat loss efficiency. The sheet metal is made of galvanised steel, treated according to UNI EN10327 and painted with RAL7035 resins with a high resistance to chemical agents

The standard degree of protection is IP 55 (IP 65 on request for transport of energy only). With certain accessories it can also be connected to Legrand RCP busbar for external installation

The busbar conductors have a rectangular cross section with rounded corners. There are two versions available :

- Electrolytic copper ETP 99.9 UNI EN 13601

- Aluminum alloy treated over the entire surface with 5 galvanic processes (copper plating and tin plating)

The insulation between bars is ensured by a double sheath

made with a polyester film and a total thickness of 2 x 0.19 mm for class B (130°C), or class F (155°C) thermal resistance with a total thickness of 2 x 0.23 mm (available on request). All plastic components have a V1 self-extinguishing degree. They are fire retardant and comply with the glow-wire test according to standards

The XCP-S line is halogen free

In order to facilitate storage operations, and to reduce the installation time, the straight lengths, trunking components and all other components of the XCP-S line are supplied with a monobloc pre-installed at the factory

The junction contact is ensured by using tin plated aluminium for XCP-S Al and copper for XCP-S Cu for each phase, insulated with red class F thermosetting plastic material

The monobloc has shearhead bolts thus after tightening the nuts with a standard wrench, the outer head will break at the correct torque value, giving you the certainty that the connection has been made properly and guarantees safety and maximum performance over time

Finally, in order to completely verify the insulation level, every finished product undergoes an insulation test (phase-phase, phase-PE) at the factory with a test voltage of 3500 Vac for 1.5 seconds


The test is performed on the finished product, completely assembled IP 55 and IP 65 is intended for internal use only, for outdoor applications RCP resin IP 68 busbar is available

RATED CURRENT OF XCP-S BARS (A)											
AI	630	800	1000	1250	1600	2000	2500	3200	4000	5000	
	Single bar						Double bar			Triple bar	
Cu		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
	Single bar						Double bar			Triple bar	

### Standard versions


**XCP-S line with 4 conductors  
3P+N+PE, 3P+PE, 3P+FE+PE, 3L+N+FE+PE**

PE : Protection earth (casing)  
FE : Functional earth (clean earth)

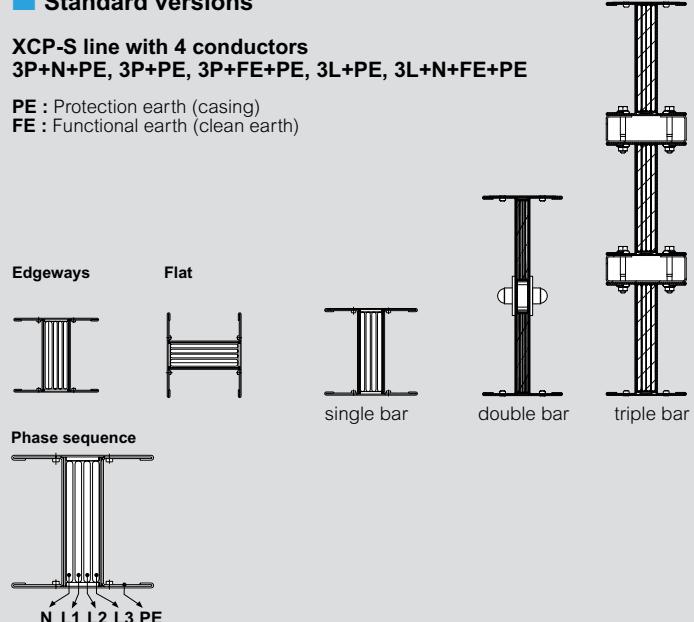


**XCP-S 5 line with 5 conductors  
3P+N+FE+PE**

PE : Protection earth (casing)  
FE : Functional earth (clean earth)



**XCP-S 2N 200% neutral line  
3P+2N+PE**

PE : Protection earth (casing)  
2N : 200% neutral



### GENERAL CORRECTION FACTOR FOR AMBIENT TEMPERATURES (Kt)

#### XCP-S (AL - CU)

Daily avg ambient temperature	-5°C	0°C	5°C	10°C	15°C	20°C	25°C	30°C	35°C	40°C	45°C	50°C
Kt factor	1.24	1.21	1.18	1.15	1.12	1.09	1.06	1.03	1	0.97	0.93	0.90

Special versions are available on request,  
contact us on +44 (0) 370 608 9020

# Xtra Compact (XCP-S)

## technical data

### XCP-S AI (4 conductors)

3P+N+PE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		630	800	1000	1250	1600	2000	2500	3200	4000	5000
Overall dimension of the busbars	L x H [mm]	120 x 130	120 x 130	120 x 130	120 x 170	120 x 200	120 x 220	120 x 380	120 x 440	120 x 480	120 x 590
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	25***	25***	36	42	42	50	65	80	100	120
Peak current	Ipk [kA]	53	53	76	88	88	105	143	176	220	264
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	312	312	1296	1764	1764	2500	4225	6400	10000	14400
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15***	15***	22	25	25	30	39	48	60	72
Peak current of the neutral bar	Ipk [kA]	30	30	46	53	53	63	82	101	132	158
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	15***	15***	22	25	25	30	39	48	60	72
Peak current of the protective circuit	Ipk [kA]	30	30	46	53	53	63	82	101	132	158
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.140	0.092	0.077	0.057	0.041	0.029	0.029	0.021	0.014	0.011
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.016	0.015	0.014	0.011	0.007	0.006	0.005
Phase impedance	Z [mΩ/m]	0.142	0.094	0.079	0.060	0.044	0.032	0.031	0.022	0.016	0.012
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.185	0.122	0.104	0.080	0.058	0.040	0.041	0.030	0.021	0.015
Phase impedance at thermal conditions	Z [mΩ/m]	0.186	0.123	0.105	0.081	0.059	0.043	0.042	0.031	0.022	0.016
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.140	0.092	0.077	0.057	0.041	0.029	0.029	0.021	0.014	0.011
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.110	0.106	0.078	0.071	0.067	0.040
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.032	0.025	0.021	0.017	0.016	0.013
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.054	0.049	0.035	0.029	0.026	0.021
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.080	0.078	0.078	0.048	0.039	0.028	0.020	0.015	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.272	0.224	0.208	0.176	0.152	0.135	0.107	0.092	0.082	0.051
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.190	0.142	0.126	0.095	0.073	0.054	0.049	0.038	0.030	0.023
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.224	0.176	0.161	0.121	0.096	0.078	0.064	0.050	0.040	0.032
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.10	0.10	0.10	0.06	0.05	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.291	0.243	0.229	0.188	0.161	0.142	0.111	0.094	0.085	0.054
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.216	0.171	0.158	0.115	0.091	0.069	0.058	0.044	0.037	0.030
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.247	0.200	0.187	0.137	0.110	0.089	0.071	0.054	0.046	0.037
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.187	0.123	0.102	0.077	0.055	0.039	0.038	0.028	0.019	0.014
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.021	0.020	0.019	0.015	0.009	0.008	0.007
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.189	0.125	0.105	0.080	0.059	0.043	0.041	0.029	0.021	0.016
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.178	0.162	0.157	0.138	0.124	0.116	0.088	0.078	0.072	0.044
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.021	0.020	0.019	0.015	0.009	0.008	0.007
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.181	0.164	0.159	0.140	0.126	0.117	0.089	0.079	0.073	0.044
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>											
$\cos\phi = 0.70$											
$\cos\phi = 0.75$											
$\cos\phi = 0.80$											
$\cos\phi = 0.85$											
$\cos\phi = 0.90$											
$\cos\phi = 0.95$											
$\cos\phi = 1.00$											
Weight (PE 1)	p [kg/m]	14.3	15.6	1.0	18.9	22.5	27.4	34.1	41.5	50.4	88.3
Weight (PE 2)	p [kg/m]	17.6	18.9	19.3	23.3	27.7	33.9	42.1	51.0	61.0	101.4
Weight (PE 3)	p [kg/m]	15.4	16.7	17.1	20.3	24.2	29.2	36.7	44.6	54.0	92.6
Fire load	[kWh/m]	4.5	5.5	5.5	6.0	8.5	10.5	16.0	19.0	21.0	21.0
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B/F**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	220	234	311	373	442	485	765	914	1000	1154
Ambient temperature min/ MAX (daily average)	[°C]	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50


\* IP 65 for feeder lines is available on request

\*\* Class F is available on request


\*\*\* Icw value at 0.5 s

For temperatures over 35°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020


The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard  
version



PE 2  
Extra earth -  
COPPER



PE 3  
Extra earth -  
ALUMINUM  
XCP AI 3L+N+50%PE  
(available on request)

# Xtra Compact (XCP-S)

## technical data

### XCP-S AI (5 conductors - clean earth)

3P+N+PE+FE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		630	800	1000	1250	1600	2000	2500	3200	4000	5000
Overall dimension of the busbars	L x H [mm]	120 x 130	120 x 130	120 x 130	120 x 170	120 x 200	120 x 220	120 x 380	120 x 440	120 x 480	120 x 590
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	25***	25***	36	42	42	50	65	80	100	120
Peak current	Ipk [kA]	53	53	76	88	88	105	143	176	220	264
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	312	312	1296	1764	1764	2500	4225	6400	10000	14400
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15***	15***	22	25	25	30	39	48	60	72
Peak current of the neutral bar	Ipk [kA]	30	30	46	53	53	63	82	101	132	158
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	15***	15***	22	25	25	30	39	48	60	72
Peak current of the protective circuit	Ipk [kA]	30	30	46	53	53	63	82	101	132	158
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.140	0.092	0.077	0.057	0.041	0.029	0.029	0.021	0.014	0.011
Phase reactance (50hz)	X [mΩ/m]	0.023	0.017	0.017	0.016	0.015	0.014	0.011	0.007	0.006	0.005
Phase impedance	Z [mΩ/m]	0.142	0.094	0.079	0.060	0.044	0.032	0.031	0.022	0.016	0.012
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.185	0.122	0.104	0.080	0.058	0.040	0.041	0.030	0.021	0.015
Phase impedance at thermal conditions	Z [mΩ/m]	0.186	0.123	0.105	0.081	0.059	0.043	0.042	0.031	0.022	0.016
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.140	0.092	0.077	0.057	0.041	0.029	0.029	0.021	0.014	0.011
Functional Earth resistance (FE)	R <sub>20</sub> [mΩ/m]	0.140	0.092	0.077	0.057	0.041	0.029	0.029	0.021	0.014	0.011
Functional Earth reactance (FE)	X [mΩ/m]	0.023	0.017	0.017	0.016	0.015	0.014	0.011	0.007	0.006	0.005
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.110	0.106	0.078	0.071	0.067	0.040
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.032	0.025	0.021	0.017	0.016	0.013
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.054	0.049	0.035	0.029	0.026	0.021
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.080	0.078	0.078	0.048	0.039	0.028	0.020	0.015	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.208	0.146	0.125	0.096	0.071	0.052	0.050	0.037	0.026	0.019
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.177	0.124	0.107	0.080	0.059	0.042	0.041	0.030	0.022	0.016
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.193	0.136	0.117	0.088	0.065	0.047	0.044	0.033	0.024	0.018
Reactance of the fault loop (50hz)	X <sub>o</sub> [mΩ/m]	0.10	0.10	0.10	0.06	0.05	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.232	0.174	0.157	0.116	0.089	0.067	0.059	0.043	0.034	0.027
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.205	0.156	0.143	0.103	0.080	0.060	0.051	0.037	0.031	0.025
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.218	0.166	0.151	0.109	0.084	0.063	0.054	0.039	0.032	0.026
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.187	0.123	0.102	0.077	0.055	0.039	0.038	0.028	0.019	0.014
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.021	0.020	0.019	0.015	0.009	0.008	0.007
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.189	0.125	0.105	0.080	0.059	0.043	0.041	0.029	0.021	0.016
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.187	0.123	0.102	0.077	0.055	0.039	0.038	0.028	0.019	0.014
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.021	0.020	0.019	0.015	0.009	0.008	0.007
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.189	0.125	0.105	0.080	0.059	0.043	0.041	0.029	0.021	0.016
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	126.3	84.4	73.4	58.1	44.1	33.2	31.5	22.4	16.3	12.4
	cosφ = 0.75	133.3	88.9	77.1	60.8	45.9	34.3	32.8	23.3	17.0	12.9
	cosφ = 0.80	140.1	93.3	80.7	63.4	47.6	35.3	34.0	24.2	17.6	13.3
	cosφ = 0.85	146.6	97.5	84.1	65.9	49.2	36.1	35.1	25.1	18.1	13.6
	cosφ = 0.90	152.8	101.5	87.3	68.0	50.5	36.8	36.0	25.8	18.5	13.9
	cosφ = 0.95	158.4	104.9	90.0	69.8	51.4	37.0	36.5	26.4	18.8	14.0
	cosφ = 1.00	160.2	105.6	89.9	68.9	49.8	35.0	35.3	25.8	18.0	13.3
Weight (PE 1)	p [kg/m]	15.3	17.0	17.6	20.9	25.2	31.1	38.3	47.1	58.0	98.2
Weight (PE 2)	p [kg/m]	18.6	20.3	20.9	25.3	30.3	37.6	46.3	56.6	68.6	111.3
Weight (PE 3)	p [kg/m]	16.4	18.0	18.7	22.3	26.9	33.0	40.9	50.2	61.5	102.5
Fire load	[kWh/m]	5.6	6.9	6.9	7.5	10.6	13.1	20.0	23.8	26.3	27.3
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	220	234	311	373	442	485	765	914	1000	1154
Ambient temperature min/ MAX (daily average)	[°C]	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50

\* IP 65 for feeder lines is available on request

\*\* Class F is available on request

\*\*\* Icw value at 0.5 s

For temperatures over 35°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard  
version



PE 2  
Extra earth -  
COPPER



PE 3  
Extra earth -  
ALUMINUM  
XCP AI 3L+N+50%PE  
(available on request)

# Xtra Compact (XCP-S)

## technical data

### XCP-S AI (5 conductors - double neutral)

3P+2N+PE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		630	800	1000	1250	1600	2000	2500	3200	4000	5000
Overall dimension of the busbars	L x H [mm]	120 x 130	120 x 130	120 x 130	120 x 170	120 x 200	120 x 220	120 x 380	120 x 440	120 x 480	120 x 590
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	25***	25***	36	42	42	50	65	80	100	120
Peak current	Ipk [kA]	53	53	76	88	88	105	143	176	220	264
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	312	312	1296	1764	1764	2500	4225	6400	10000	14400
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15***	15***	22	25	25	30	39	48	60	72
Peak current of the neutral bar	Ipk [kA]	30	30	46	53	53	63	82	101	132	158
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	15***	15***	22	25	25	30	39	48	60	72
Peak current of the protective circuit	Ipk [kA]	30	30	46	53	53	63	82	101	132	158
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.140	0.092	0.077	0.057	0.041	0.029	0.029	0.021	0.014	0.011
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.016	0.015	0.014	0.011	0.007	0.006	0.005
Phase impedance	Z [mΩ/m]	0.142	0.094	0.079	0.060	0.044	0.032	0.031	0.022	0.016	0.012
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.185	0.122	0.104	0.080	0.058	0.040	0.041	0.030	0.021	0.015
Phase impedance at thermal conditions	Z [mΩ/m]	0.186	0.123	0.105	0.081	0.059	0.043	0.042	0.031	0.022	0.016
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.070	0.046	0.038	0.029	0.021	0.014	0.014	0.010	0.007	0.005
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.110	0.106	0.078	0.071	0.067	0.040
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.032	0.025	0.021	0.017	0.016	0.013
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.054	0.049	0.035	0.029	0.026	0.021
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.080	0.078	0.078	0.048	0.039	0.028	0.020	0.015	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.272	0.224	0.208	0.176	0.152	0.135	0.107	0.092	0.082	0.051
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.190	0.142	0.126	0.095	0.073	0.054	0.049	0.038	0.030	0.023
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.224	0.176	0.161	0.121	0.096	0.078	0.064	0.050	0.040	0.032
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.10	0.10	0.10	0.06	0.05	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.291	0.243	0.229	0.188	0.161	0.142	0.111	0.094	0.085	0.054
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.216	0.171	0.158	0.115	0.091	0.069	0.058	0.044	0.037	0.030
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.247	0.200	0.187	0.137	0.110	0.089	0.071	0.054	0.046	0.037
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.117	0.077	0.064	0.048	0.034	0.024	0.024	0.017	0.012	0.009
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.019	0.014	0.014	0.013	0.013	0.012	0.009	0.006	0.005	0.004
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.118	0.078	0.066	0.050	0.037	0.027	0.026	0.018	0.013	0.010
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.178	0.162	0.157	0.138	0.124	0.116	0.088	0.078	0.072	0.044
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.021	0.020	0.019	0.015	0.009	0.008	0.007
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.181	0.164	0.159	0.140	0.126	0.117	0.089	0.079	0.073	0.044
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	126.3	84.4	73.4	58.1	44.1	33.2	31.5	22.4	16.3	12.4
	cosφ = 0.75	133.3	88.9	77.1	60.8	45.9	34.3	32.8	23.3	17.0	12.9
	cosφ = 0.80	140.1	93.3	80.7	63.4	47.6	35.3	34.0	24.2	17.6	13.3
	cosφ = 0.85	146.6	97.5	84.1	65.9	49.2	36.1	35.1	25.1	18.1	13.6
	cosφ = 0.90	152.8	101.5	87.3	68.0	50.5	36.8	36.0	25.8	18.5	13.9
	cosφ = 0.95	158.4	104.9	90.0	69.8	51.4	37.0	36.5	26.4	18.8	14.0
	cosφ = 1.00	160.2	105.6	89.9	68.9	49.8	35.0	35.3	25.8	18.0	13.3
Weight (PE 1)	p [kg/m]	15.3	17.0	17.6	20.9	25.2	31.1	38.3	47.1	58.0	98.2
Weight (PE 2)	p [kg/m]	18.6	20.3	20.9	25.3	30.3	37.6	46.3	56.6	68.6	111.3
Weight (PE 3)	p [kg/m]	16.4	18.0	18.7	22.3	26.9	33.0	40.9	50.2	61.5	102.5
Fire load	[kWh/m]	5.6	6.9	6.9	7.5	10.6	13.1	20.0	23.8	26.3	27.3
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	220	234	311	373	442	485	765	914	1000	1154
Ambient temperature min/ MAX (daily average)	[°C]	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50



\* IP 65 for feeder lines is available on request

\*\* Class F is available on request


\*\*\* Icw value at 0.5 s

For temperatures over 35°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 2  
Extra earth -  
COPPER



PE 3  
Extra earth -  
ALUMINUM  
XCP AI 3L+N+50%PE  
(available on request)

# Xtra Compact (XCP-S)

## technical data

### XCP-S CU (4 conductors)


3P+N+PE	In [A]	SINGLE BAR					DOUBLE BAR				TRIPLE BAR
Rated current		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Overall dimension of the busbars	L x H [mm]	120 x 130	120 x 130	120 x 130	120 x 170	120 x 200	120 x 300	120 x 380	120 x 440	120 x 480	120 x 590
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	25	36	42	42	50	65	80	100	120	150
Peak current	Ipk [kA]	53	76	88	88	105	143	176	220	264	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	625	1296	1764	1764	2500	4225	6400	10000	14400	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the neutral bar	Ipk [kA]	30	46	53	53	63	82	101	132	158	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the protective circuit	Ipk [kA]	30	46	53	53	63	82	101	132	158	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.058	0.045	0.034	0.024	0.021	0.017	0.012	0.008	0.0062
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.0050
Phase impedance	Z [mΩ/m]	0.080	0.061	0.048	0.037	0.028	0.024	0.018	0.014	0.010	0.0079
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.100	0.081	0.061	0.045	0.034	0.029	0.024	0.017	0.011	0.0085
Phase impedance at thermal conditions	Z [mΩ/m]	0.103	0.082	0.063	0.048	0.036	0.031	0.025	0.018	0.012	0.0099
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.077	0.058	0.045	0.034	0.024	0.021	0.017	0.012	0.008	0.0062
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.110	0.090	0.078	0.071	0.067	0.0402
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.032	0.025	0.021	0.017	0.016	0.0125
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.054	0.042	0.035	0.029	0.026	0.0213
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.054	0.054	0.054	0.044	0.044	0.032	0.022	0.017	0.016	0.0140
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.209	0.190	0.176	0.153	0.135	0.111	0.095	0.083	0.075	0.0464
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.126	0.108	0.094	0.072	0.056	0.046	0.038	0.029	0.023	0.0187
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.161	0.143	0.129	0.098	0.079	0.063	0.052	0.041	0.033	0.0275
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.08	0.07	0.07	0.06	0.06	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.222	0.203	0.190	0.164	0.147	0.119	0.099	0.087	0.078	0.0501
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.148	0.129	0.118	0.093	0.081	0.063	0.047	0.037	0.032	0.0267
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.179	0.159	0.147	0.114	0.098	0.076	0.059	0.047	0.040	0.0334
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.103	0.078	0.060	0.045	0.033	0.028	0.023	0.016	0.010	0.0082
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.009	0.008	0.008	0.0067
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.107	0.081	0.064	0.050	0.038	0.032	0.025	0.018	0.013	0.0106
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.157	0.151	0.147	0.130	0.118	0.097	0.084	0.075	0.070	0.0423
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.062	0.060	0.060	0.049	0.049	0.036	0.024	0.019	0.018	0.0157
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.169	0.163	0.158	0.139	0.128	0.103	0.087	0.078	0.072	0.0451
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	75.1	59.5	47.2	36.7	29.0	24.5	19.2	14.1	10.3	8.3
	cosφ = 0.75	78.4	62.2	49.1	37.9	29.9	25.3	19.9	14.6	10.5	8.4
	cosφ = 0.80	81.5	64.8	50.8	39.1	30.6	25.9	20.6	15.0	10.7	8.5
	cosφ = 0.85	84.4	67.2	52.3	40.1	31.1	26.5	21.2	15.4	10.7	8.6
	cosφ = 0.90	86.9	69.3	53.6	40.9	31.5	26.9	21.7	15.6	10.7	8.5
	cosφ = 0.95	88.8	71.0	54.4	41.2	31.4	27.0	22.0	15.7	10.6	8.4
	cosφ = 1.00	86.9	69.9	52.4	39.1	29.1	25.3	21.2	14.8	9.4	7.4
Weight (PE 1)	p [kg/m]	21.2	23.8	26.9	33.5	42.5	51.0	63.0	80.9	114.9	165.1
Weight (PE 2)	p [kg/m]	24.5	27.1	30.2	37.8	47.6	57.7	71.0	90.4	125.4	178.2
Weight (PE 3)	p [kg/m]	22.3	24.9	28.0	34.9	44.2	53.2	65.6	84.0	118.4	169.3
Fire load	[kWh/m]	4.5	5.5	5.5	8.0	8.2	10.5	16.0	19.0	21.0	22.0
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	193	242	284	347	403	547	752	823	816	1015
Ambient temperature min/ MAX (daily average)	[°C]	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50

\* IP 65 for feeder lines is available on request


\*\* Class F is available on request

For temperatures over 35°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard  
version



PE 2  
Extra earth -  
COPPER XCP Cu 3L+N+50%PE  
(tinned copper conductors available on request)



PE 3  
Extra earth -  
ALUMINUM

# Xtra Compact (XCP-S)

## technical data

### XCP-S CU (5 conductors - clean earth)


3P+N+PE+FE	In [A]	SINGLE BAR					DOUBLE BAR				TRIPLE BAR
Rated current		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Overall dimension of the busbars	L x H [mm]	120 x 130	120 x 130	120 x 130	120 x 170	120 x 200	120 x 300	120 x 380	120 x 440	120 x 480	120 x 590
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	25	36	42	42	50	65	80	100	120	150
Peak current	Ipk [kA]	53	76	88	88	105	143	176	220	264	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	625	1296	1764	1764	2500	4225	6400	10000	14400	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the neutral bar	Ipk [kA]	30	46	53	53	63	82	101	132	158	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the protective circuit	Ipk [kA]	30	46	53	53	63	82	101	132	158	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.058	0.045	0.034	0.024	0.021	0.017	0.012	0.008	0.0062
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.0050
Phase impedance	Z [mΩ/m]	0.080	0.061	0.048	0.037	0.028	0.024	0.018	0.014	0.010	0.0079
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.100	0.081	0.061	0.045	0.034	0.029	0.024	0.017	0.011	0.0085
Phase impedance at thermal conditions	Z [mΩ/m]	0.103	0.082	0.063	0.048	0.036	0.031	0.025	0.018	0.012	0.0099
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.077	0.058	0.045	0.034	0.024	0.021	0.017	0.012	0.008	0.0062
Functional Earth resistance (FE)	R <sub>20</sub> [mΩ/m]	0.077	0.058	0.045	0.034	0.024	0.021	0.017	0.012	0.008	0.0062
Functional Earth reactance (FE)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.0050
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.133	0.133	0.133	0.120	0.111	0.090	0.079	0.072	0.068	0.0412
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.032	0.025	0.021	0.017	0.016	0.0125
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.054	0.042	0.035	0.029	0.026	0.0213
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.054	0.054	0.054	0.044	0.044	0.032	0.022	0.017	0.016	0.0140
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.126	0.099	0.078	0.060	0.045	0.038	0.031	0.023	0.015	0.0115
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.107	0.085	0.068	0.052	0.038	0.032	0.026	0.019	0.013	0.0103
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.117	0.093	0.074	0.056	0.041	0.035	0.028	0.021	0.014	0.0109
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.077	0.071	0.071	0.059	0.058	0.043	0.029	0.023	0.022	0.0190
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.147	0.122	0.106	0.084	0.073	0.058	0.042	0.032	0.026	0.0222
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.132	0.111	0.098	0.079	0.070	0.054	0.039	0.030	0.025	0.0216
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.140	0.117	0.102	0.081	0.071	0.056	0.041	0.031	0.026	0.0219
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.103	0.078	0.060	0.045	0.033	0.028	0.023	0.016	0.010	0.0082
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.009	0.008	0.008	0.0067
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.107	0.081	0.064	0.050	0.038	0.032	0.025	0.018	0.013	0.0106
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.103	0.078	0.060	0.045	0.033	0.028	0.023	0.016	0.010	0.0082
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.009	0.008	0.008	0.0067
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.107	0.081	0.064	0.050	0.038	0.032	0.025	0.018	0.013	0.0106
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	75.1	59.5	47.2	36.7	29.0	24.5	19.2	14.1	10.3	8.3
	cosφ = 0.75	78.4	62.2	49.1	37.9	29.9	25.3	19.9	14.6	10.5	8.4
	cosφ = 0.80	81.5	64.8	50.8	39.1	30.6	25.9	20.6	15.0	10.7	8.5
	cosφ = 0.85	84.4	67.2	52.3	40.1	31.1	26.5	21.2	15.4	10.7	8.6
	cosφ = 0.90	86.9	69.3	53.6	40.9	31.5	26.9	21.7	15.6	10.7	8.5
	cosφ = 0.95	88.8	71.0	54.4	41.2	31.4	27.0	22.0	15.7	10.6	8.4
	cosφ = 1.00	86.9	69.9	52.4	39.1	29.1	25.3	21.2	14.8	9.4	7.4
Weight (PE 1)	p [kg/m]	23.7	27.1	31.0	38.9	49.9	59.9	74.1	96.0	138.1	193.1
Weight (PE 2)	p [kg/m]	27.1	30.4	34.4	43.3	55.1	66.5	82.1	105.5	148.6	206.2
Weight (PE 3)	p [kg/m]	24.8	28.1	32.1	40.3	51.6	62.0	76.7	99.1	141.6	197.4
Fire load	[kWh/m]	5.6	6.9	6.9	10.0	10.3	13.1	20.0	23.8	26.3	27.3
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	193	242	284	347	403	547	752	823	816	1015
Ambient temperature min/ MAX (daily average)	[°C]	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50

\* IP 65 for feeder lines is available on request

\*\* Class F is available on request

For temperatures over 35°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard version



PE 2  
Extra earth - COPPER  
XCP Cu 3L+N+50%PE  
(tinned copper conductors available on request)



PE 3  
Extra earth - ALUMINUM

# Xtra Compact (XCP-S)

## technical data

### XCP-S CU (5 conductors - double neutral)

3P+2N+PE	In [A]	SINGLE BAR					DOUBLE BAR				TRIPLE BAR
		800	1000	1250	1600	2000	2500	3200	4000	5000	
<b>Rated current</b>											
Overall dimension of the busbars	L x H [mm]	120 x 130	120 x 130	120 x 130	120 x 170	120 x 200	120 x 300	120 x 380	120 x 440	120 x 480	120 x 590
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	25	36	42	42	50	65	80	100	120	150
Peak current	Ipk [kA]	53	76	88	88	105	143	176	220	264	330
Allowable specific energy for three phase fault	I <sup>t</sup> [MA <sup>2</sup> s]	625	1296	1764	1764	2500	4225	6400	10000	14400	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the neutral bar	Ipk [kA]	30	46	53	53	63	82	101	132	158	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	15	22	25	25	30	39	48	60	72	90
Peak current of the protective circuit	Ipk [kA]	30	46	53	53	63	82	101	132	158	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.058	0.045	0.034	0.024	0.021	0.017	0.012	0.008	0.0062
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.0050
Phase impedance	Z [mΩ/m]	0.080	0.061	0.048	0.037	0.028	0.024	0.018	0.014	0.010	0.0079
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.100	0.081	0.061	0.045	0.034	0.029	0.024	0.017	0.011	0.0085
Phase impedance at thermal conditions	Z [mΩ/m]	0.103	0.082	0.063	0.048	0.036	0.031	0.025	0.018	0.012	0.0099
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.038	0.029	0.022	0.017	0.012	0.011	0.008	0.006	0.004	0.0031
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.133	0.133	0.133	0.120	0.111	0.090	0.079	0.072	0.068	0.0412
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.032	0.025	0.021	0.017	0.016	0.0125
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.054	0.042	0.035	0.029	0.026	0.0213
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.054	0.054	0.054	0.044	0.044	0.032	0.022	0.017	0.016	0.0140
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.210	0.192	0.178	0.154	0.135	0.111	0.096	0.084	0.076	0.0473
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.126	0.108	0.094	0.072	0.056	0.046	0.038	0.029	0.023	0.0187
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.161	0.143	0.129	0.098	0.079	0.063	0.052	0.041	0.033	0.0275
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.077	0.071	0.071	0.059	0.058	0.043	0.029	0.023	0.022	0.0190
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.224	0.204	0.191	0.165	0.147	0.119	0.100	0.087	0.079	0.0510
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.148	0.129	0.118	0.093	0.081	0.063	0.047	0.037	0.032	0.0267
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.179	0.159	0.147	0.114	0.098	0.076	0.059	0.047	0.040	0.0334
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.064	0.049	0.037	0.028	0.020	0.018	0.014	0.010	0.006	0.0051
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.019	0.014	0.014	0.013	0.012	0.009	0.006	0.005	0.005	0.0042
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.067	0.051	0.040	0.031	0.024	0.020	0.015	0.011	0.008	0.0066
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.157	0.151	0.147	0.130	0.118	0.097	0.084	0.075	0.070	0.0423
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.062	0.060	0.060	0.049	0.049	0.036	0.024	0.019	0.018	0.0157
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.169	0.163	0.158	0.139	0.128	0.103	0.087	0.078	0.072	0.0451
Voltage drop with distributed load ΔV [V/(m*A)] <sup>10^-6</sup>	cosφ = 0,70	75·1	59·5	47·2	36·7	29·0	24·5	19·2	14·1	10·3	8·3
	cosφ = 0,75	78·4	62·2	49·1	37·9	29·9	25·3	19·9	14·6	10·5	8·4
	cosφ = 0,80	81·5	64·8	50·8	39·1	30·6	25·9	20·6	15·0	10·7	8·5
	cosφ = 0,85	84·4	67·2	52·3	40·1	31·1	26·5	21·2	15·4	10·7	8·6
	cosφ = 0,90	86·9	69·3	53·6	40·9	31·5	26·9	21·7	15·6	10·7	8·5
	cosφ = 0,95	88·8	71·0	54·4	41·2	31·4	27·0	22·0	15·7	10·6	8·4
	cosφ = 1,00	86·9	69·9	52·4	39·1	29·1	25·3	21·2	14·8	9·4	7·4
Weight (PE 1)	p [kg/m]	23·7	27·1	31·0	38·9	49·9	59·9	74·1	96·0	138·1	193·1
Weight (PE 2)	p [kg/m]	27·1	30·4	34·4	43·3	55·1	66·5	82·1	105·5	148·6	206·2
Weight (PE 3)	p [kg/m]	24·8	28·1	32·1	40·3	51·6	62·0	76·7	99·1	141·6	197·4
Fire load	[kWh/m]	5·6	6·9	6·9	10·0	10·3	13·1	20·0	23·8	26·3	27·3
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	193	242	284	347	403	547	752	823	816	1015
Ambient temperature min/ MAX (daily average)	[°C]	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50	-5/+50

\* IP 65 for feeder lines is available on request

\*\* Class F is available on request

For temperatures over 35°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard version



PE 2  
Extra earth - COPPER XCP Cu 3L+N+50%PE (tinned copper conductors available on request)



PE 3  
Extra earth - ALUMINUM



# XCP-HP

The high performance power solution for industrial and service sector applications

## BUSBAR FROM 630 TO 6300 A

XCP-HP is a busbar trunking system characterised by high performance and low losses due to the Joule effect. Used for transport and distribution of high power, including rising mains. Applications include all industrial, commercial and service sector buildings such as factories, banks, trade and business centres, hospitals and data centres etc.

# Xtra Compact (XCP-HP)

## technical information

### General features

XCP-HP is available in the following configurations :

**From 630 A to 5000 A with aluminum alloy conductors and from 800 A to 6300 A with copper conductors**

The extra-compact dimensions of XCP-HP enhance its resistance to short circuit stresses. In addition, it can reduce the impedance of the circuit by controlling the voltage drops and allowing for the installation of high power electrical systems, even in extremely confined spaces.

XCP-HP is available with a wide selection of tap-off boxes

**that range from 32 A up to 1250 A**, thus allowing you to locally protect and feed different types of loads by housing protective devices such as fuses, MCBs, MCCBs and motorised switches.

XCP-HP is not only in compliance with the harmonised standards,

**IEC EN 61439-6**, but also answers specifically to many clients' needs

for more severe conditions.

Thus the rated current of Legrand's busbar trunking systems is referred to the average ambient temperature of 50°C for aluminium and 55°C for copper

The nominal range of all XCP-HP is guaranteed both for horizontal installations (flat and edgeways) and for vertical installations without derating

XCP-HP busbar trunking systems are designed so that they can be relatively maintenance-free, except for the periodic and compulsory inspections required by the standard BS 7671

The tightening torque inspection of the junction can be carried out by qualified personnel, even when the busbar is energised

### Structural features

The outer casing of the XCP-HP line consists of four C-ribbed section bars, bordered and riveted (thickness 1.5mm), with excellent mechanical, electric and heat loss efficiency

The sheet metal is made of galvanised steel, treated according to UNI EN10327 and painted with RAL7035 resins with a high resistance to chemical agents

The standard degree of protection is IP 55 (IP 65 on request for transport of energy only). With certain accessories it can also be connected to Legrand RCP busbar for external installation

The busbar conductors have a rectangular cross section with rounded corners. There are two versions available :

- Electrolytic copper ETP 99.9 UNI EN 13601
- Aluminum alloy treated over the entire surface with 5 galvanic processes (copper plating and tin plating)

The insulation between bars is ensured by a double sheath made with a polyester film and a total thickness of 2 x 0.19 mm for class B (130°C), or class F (155°C) thermal resistance with a total thickness of 2 x 0.23 mm (available on request). All plastic components have a V1 self-extinguishing degree. They are fire retardant and comply with the glow-wire test according to standards

The XCP-HP line is halogen free

In order to facilitate storage operations, and to reduce the installation time, the straight lengths, trunking components and all other components of the XCP-HP line are supplied with a monobloc pre-installed at the factory

The junction contact is ensured by using tin plated aluminium for XCP-HP AI and copper for XCP-HP Cu for each phase, insulated with red class F thermosetting plastic material

The monobloc has shearhead bolts thus after tightening the nuts with a standard wrench, the outer head will break at the correct torque value, giving you the certainty that the connection has been made properly and guarantees safety and maximum performance over time

Finally, in order to completely verify the insulation level, every finished product undergoes an insulation test (phase-phase, phase-PE) at the factory with a test voltage of 3500 Vac for 1.5 seconds. The test is performed on the finished product, completely assembled.

IP 55 and IP 65 is intended for internal use only, for outdoor applications RCP resin IP 68 busbar is available

RATED CURRENT OF XCP-HP BARS (A)											
AI	630	800	1000	1250	1600	2000	2500	3200	4000	5000	
	Single bar								Double bar		Triple bar
Cu		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
	Single bar								Double bar		Triple bar

### Standard versions :

#### XCP-HP line with 4 conductors 3P+N+PE, 3P+PEN, 3P+FE+PE

PE : Protection earth (casing)  
FE : Functional earth (clean earth)


Edgeways



Flat




Phase sequence



#### XCP-HP 5 line with 5 conductors 3P+N+FE+PE

PE : Protection earth (casing)  
FE : Functional earth (clean earth)


Phase sequence



#### XCP-HP 2N 200% neutral line 3P+2N+PE

PE : Protection earth (casing)  
2N : 200% neutral

Phase sequence



### GENERAL CORRECTION FACTOR FOR AMBIENT TEMPERATURES (Kt)

#### XCP-HP (AL)

Daily avg ambient temperature	-5°C	0°C	5°C	10°C	15°C	20°C	25°C	30°C	35°C	40°C	45°C	50°C	55°C	60°C	65°C	70°C
Kt factor	1.38	1.34	1.31	1.28	1.25	1.21	1.18	1.15	1.11	1.07	1.04	1	0.96	0.92	0.88	0.84

#### XCP-HP (CU)

Daily avg ambient temperature	-5°C	0°C	5°C	10°C	15°C	20°C	25°C	30°C	35°C	40°C	45°C	50°C	55°C	60°C	65°C	70°C
Kt factor	1.43	1.40	1.37	1.33	1.30	1.26	1.23	1.19	1.16	1.12	1.08	1.04	1	0.96	0.92	0.87

Special versions are available on request,  
contact us on +44 (0) 370 608 9020

# Xtra Compact (XCP-HP)

## technical data

### XCP-HP AI (4 conductors)


3P+N+PE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		630	800	1000	1250	1600	2000	2500	3200	4000	5000
Overall dimension of the busbars	L x H [mm]	125 x 130	125 x 130	125 x 130	125 x 130	125 x 200	125 x 220	125 x 380	125 x 440	125 x 480	125 x 740
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	36	36	50	70	70	85	120	120	150	150
Peak current	Ipk [kA]	76	76	105	154	154	187	264	264	330	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	1296	1296	2500	4900	4900	7225	14400	14400	22500	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the neutral bar	Ipk [kA]	45	45	63	88	88	112	158	158	198	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the protective circuit	Ipk [kA]	45	45	63	88	88	112	158	158	198	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.077	0.056	0.045	0.031	0.025	0.022	0.015	0.012	0.010
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.006	0.006	0.006	0.005
Phase impedance	Z [mΩ/m]	0.080	0.079	0.059	0.047	0.034	0.027	0.023	0.017	0.014	0.011
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.101	0.102	0.076	0.062	0.043	0.035	0.032	0.022	0.018	0.014
Phase impedance at thermal conditions	Z [mΩ/m]	0.104	0.103	0.078	0.064	0.045	0.037	0.032	0.023	0.019	0.015
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.077	0.077	0.056	0.045	0.031	0.025	0.022	0.015	0.012	0.010
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.133	0.111	0.106	0.078	0.072	0.068	0.035
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.049	0.032	0.029	0.019	0.016	0.014	0.010
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.084	0.054	0.049	0.032	0.027	0.025	0.016
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.080	0.078	0.078	0.048	0.039	0.028	0.020	0.015	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.208	0.208	0.188	0.178	0.142	0.131	0.101	0.087	0.080	0.045
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.126	0.126	0.106	0.094	0.063	0.054	0.041	0.031	0.027	0.019
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.161	0.161	0.140	0.129	0.085	0.074	0.054	0.043	0.037	0.026
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.10	0.10	0.10	0.06	0.05	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.232	0.229	0.210	0.189	0.151	0.137	0.104	0.089	0.083	0.049
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.163	0.158	0.142	0.114	0.082	0.067	0.049	0.038	0.035	0.027
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.191	0.187	0.169	0.144	0.100	0.084	0.060	0.047	0.043	0.032
Zero-sequence short-circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.102	0.102	0.075	0.060	0.041	0.033	0.030	0.021	0.017	0.013
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.008	0.008	0.008	0.007
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.107	0.105	0.078	0.063	0.045	0.036	0.031	0.022	0.018	0.014
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.157	0.157	0.150	0.148	0.121	0.115	0.086	0.077	0.072	0.039
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.088	0.084	0.084	0.053	0.044	0.032	0.022	0.017	0.018	0.016
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.180	0.178	0.172	0.157	0.129	0.119	0.088	0.079	0.074	0.042
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	75.6	72.1	56.5	47.0	34.7	27.9	23.0	17.2	14.6	11.5
	cosφ = 0.75	79.0	75.7	59.0	49.0	36.0	28.9	24.1	17.9	15.1	11.9
	cosφ = 0.80	82.1	79.2	61.3	50.9	37.1	29.9	25.1	18.5	15.6	12.2
	cosφ = 0.85	85.1	82.6	63.5	52.7	38.1	30.7	26.1	19.1	16.0	12.5
	cosφ = 0.90	87.7	85.6	65.5	54.2	38.8	31.3	27.0	19.6	16.3	12.7
	cosφ = 0.95	89.6	88.2	66.9	55.3	39.2	31.7	27.8	19.9	16.4	12.8
	cosφ = 1.00	87.7	88.0	65.6	53.9	37.3	30.2	27.5	19.3	15.6	12.0
Weight (PE 1)	p [kg/m]	16.0	16.0	17.8	19.3	25.4	29.4	37.7	47.3	54.3	91.0
Weight (PE 2)	p [kg/m]	19.3	19.3	21.1	22.6	30.5	35.0	46.4	57.6	65.7	108.0
Weight (PE 3)	p [kg/m]	17.1	17.1	18.9	20.3	27.1	31.2	40.5	50.7	58.0	96.5
Fire load	[kWh/m]	4.5	5.5	5.5	6.0	8.5	10.5	16.0	19.0	21.0	21.0
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	121	195	227	292	330	418	596	683	863	1042
Ambient temperature min/ MAX (daily average)	[°C]	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70

\* IP 65 for feeder lines is available on request


\*\* Class F is available on request

Data measured in accordance with IEC 61439-6  
For temperatures over 50°C it will be necessary to derate the busbar and for ambient temperatures under -5°C contact the technical support on +44 (0) 370 608 9020


The data on this page refers to the 50 Hz frequency. For 60 Hz, please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard  
version



PE 2  
Extra earth -  
COPPER



PE 3  
Extra earth -  
ALUMINUM  
XCP AI 3L+N+50%PE  
(available on request)

# Xtra Compact (XCP-HP)

## technical data

### XCP-HP AI (5 conductors - clean earth)

3P+N+PE+FE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current	In [A]	630	800	1000	1250	1600	2000	2500	3200	4000	5000
Overall dimension of the busbars	L x H [mm]	125 x 130	125 x 130	125 x 130	125 x 130	125 x 200	125 x 220	125 x 380	125 x 440	125 x 480	125 x 740
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	36	36	50	70	70	85	120	120	150	150
Peak current	Ipk [kA]	76	76	105	154	154	187	264	264	330	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	1296	1296	2500	4900	4900	7225	14400	14400	22500	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the neutral bar	Ipk [kA]	45	45	63	88	88	112	158	158	198	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the protective circuit	Ipk [kA]	45	45	63	88	88	112	158	158	198	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.077	0.056	0.045	0.031	0.025	0.022	0.015	0.012	0.010
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.006	0.006	0.006	0.005
Phase impedance	Z [mΩ/m]	0.080	0.079	0.059	0.047	0.034	0.027	0.023	0.017	0.014	0.011
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.101	0.102	0.076	0.062	0.043	0.035	0.032	0.022	0.018	0.014
Phase impedance at thermal conditions	Z [mΩ/m]	0.104	0.103	0.078	0.064	0.045	0.037	0.032	0.023	0.019	0.015
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.077	0.077	0.056	0.045	0.031	0.025	0.022	0.015	0.012	0.010
Functional Earth resistance (FE)	R <sub>20</sub> [mΩ/m]	0.077	0.077	0.056	0.045	0.031	0.025	0.022	0.015	0.012	0.010
Functional Earth reactance (FE)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.006	0.006	0.006	0.005
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.133	0.133	0.266	0.266	0.222	0.213	0.156	0.143	0.136	0.035
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.049	0.032	0.029	0.019	0.016	0.014	0.010
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.084	0.054	0.049	0.032	0.027	0.025	0.016
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.080	0.078	0.078	0.048	0.039	0.028	0.020	0.015	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.125	0.125	0.102	0.083	0.058	0.047	0.042	0.029	0.024	0.017
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.107	0.107	0.082	0.069	0.047	0.038	0.033	0.023	0.019	0.014
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.117	0.117	0.090	0.074	0.051	0.042	0.036	0.025	0.021	0.016
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.10	0.10	0.10	0.06	0.05	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.162	0.157	0.140	0.105	0.079	0.061	0.049	0.036	0.032	0.026
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.148	0.143	0.126	0.093	0.071	0.055	0.042	0.031	0.029	0.024
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.156	0.151	0.131	0.097	0.073	0.057	0.044	0.033	0.030	0.025
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.102	0.102	0.075	0.060	0.041	0.033	0.030	0.021	0.017	0.013
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.008	0.008	0.008	0.007
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.107	0.105	0.078	0.063	0.045	0.036	0.031	0.022	0.018	0.014
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.102	0.102	0.075	0.060	0.041	0.033	0.030	0.021	0.017	0.013
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.008	0.008	0.008	0.007
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.107	0.105	0.078	0.063	0.045	0.036	0.031	0.022	0.018	0.014
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	75.6	72.1	56.5	47.0	34.7	27.9	23.0	17.2	14.6	11.5
	cosφ = 0.75	79.0	75.7	59.0	49.0	36.0	28.9	24.1	17.9	15.1	11.9
	cosφ = 0.80	82.1	79.2	61.3	50.9	37.1	29.9	25.1	18.5	15.6	12.2
	cosφ = 0.85	85.1	82.6	63.5	52.7	38.1	30.7	26.1	19.1	16.0	12.5
	cosφ = 0.90	87.7	85.6	65.5	54.2	38.8	31.3	27.0	19.6	16.3	12.7
	cosφ = 0.95	89.6	88.2	66.9	55.3	39.2	31.7	27.8	19.9	16.4	12.8
	cosφ = 1.00	87.7	88.0	65.6	53.9	37.3	30.2	27.5	19.3	15.6	12.0
Weight (PE 1)	p [kg/m]	17.5	17.5	19.7	21.7	28.8	33.6	42.8	54.4	62.9	102.2
Weight (PE 2)	p [kg/m]	20.8	20.8	23.0	25.0	34.0	39.3	51.5	64.7	74.2	119.2
Weight (PE 3)	p [kg/m]	21.0	18.6	20.8	22.7	30.5	35.5	45.6	57.7	66.6	107.8
Fire load	[kWh/m]	5.6	6.9	6.9	7.5	10.6	13.1	20.0	23.8	26.3	27.3
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	121	195	227	292	330	418	596	683	863	1042
Ambient temperature min/ MAX (daily average)	[°C]	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70

\* IP 65 for feeder lines is available on request

\*\* Class F is available on request

Data measured in accordance with IEC 61439-6

For temperatures over 50°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard  
version



PE 2  
Extra earth -  
COPPER



PE 3  
Extra earth -  
ALUMINUM  
XCP AI 3L+N+50%PE  
(available on request)

# Xtra Compact (XCP-HP)

## technical data

### XCP-HP AI (5 conductors - double neutral)

3P+2N+PE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current	In [A]	630	800	1000	1250	1600	2000	2500	3200	4000	5000
Overall dimension of the busbars	L x H [mm]	125 x 130	125 x 130	125 x 130	125 x 130	125 x 200	125 x 220	125 x 380	125 x 440	125 x 480	125 x 740
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	36	36	50	70	70	85	120	120	150	150
Peak current	Ipk [kA]	76	76	105	154	154	187	264	264	330	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	1296	1296	2500	4900	4900	7225	14400	14400	22500	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the neutral bar	Ipk [kA]	45	45	63	88	88	112	158	158	198	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	22	22	30	42	42	51	72	72	90	90
Peak current of the protective circuit	Ipk [kA]	45	45	63	88	88	112	158	158	198	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.077	0.056	0.045	0.031	0.025	0.022	0.015	0.012	0.010
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.006	0.006	0.006	0.005
Phase impedance	Z [mΩ/m]	0.080	0.079	0.059	0.047	0.034	0.027	0.023	0.017	0.014	0.011
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.101	0.102	0.076	0.062	0.043	0.035	0.032	0.022	0.018	0.014
Phase impedance at thermal conditions	Z [mΩ/m]	0.104	0.103	0.078	0.064	0.045	0.037	0.032	0.023	0.019	0.015
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.038	0.038	0.028	0.022	0.015	0.012	0.011	0.008	0.006	0.005
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.133	0.133	0.266	0.266	0.222	0.213	0.156	0.143	0.136	0.035
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.049	0.032	0.029	0.019	0.016	0.014	0.010
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.084	0.054	0.049	0.032	0.027	0.025	0.016
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.080	0.078	0.078	0.048	0.039	0.028	0.020	0.015	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.210	0.210	0.322	0.311	0.253	0.238	0.179	0.158	0.148	0.045
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.126	0.126	0.106	0.094	0.063	0.054	0.041	0.031	0.027	0.019
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.161	0.161	0.140	0.129	0.085	0.074	0.054	0.043	0.037	0.026
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.10	0.10	0.10	0.06	0.05	0.04	0.03	0.02	0.02	0.02
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.234	0.230	0.336	0.318	0.258	0.241	0.181	0.160	0.150	0.049
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.163	0.158	0.142	0.114	0.082	0.067	0.049	0.038	0.035	0.027
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.191	0.187	0.169	0.144	0.100	0.084	0.060	0.047	0.043	0.032
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.064	0.064	0.047	0.037	0.026	0.021	0.019	0.013	0.010	0.008
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.019	0.014	0.014	0.013	0.012	0.009	0.005	0.005	0.005	0.004
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.247	0.225	0.225	0.212	0.206	0.228	0.159	0.177	0.114	0.114
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.157	0.157	0.150	0.148	0.121	0.115	0.086	0.077	0.072	0.039
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.088	0.084	0.084	0.053	0.044	0.032	0.022	0.017	0.018	0.016
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.180	0.178	0.172	0.157	0.129	0.119	0.088	0.079	0.074	0.042
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	75.6	72.1	56.5	47.0	34.7	27.9	23.0	17.2	14.6	11.5
	cosφ = 0.75	79.0	75.7	59.0	49.0	36.0	28.9	24.1	17.9	15.1	11.9
	cosφ = 0.80	82.1	79.2	61.3	50.9	37.1	29.9	25.1	18.5	15.6	12.2
	cosφ = 0.85	85.1	82.6	63.5	52.7	38.1	30.7	26.1	19.1	16.0	12.5
	cosφ = 0.90	87.7	85.6	65.5	54.2	38.8	31.3	27.0	19.6	16.3	12.7
	cosφ = 0.95	89.6	88.2	66.9	55.3	39.2	31.7	27.8	19.9	16.4	12.8
	cosφ = 1.00	87.7	88.0	65.6	53.9	37.3	30.2	27.5	19.3	15.6	12.0
Weight (PE 1)	p [kg/m]	17.5	17.5	19.7	21.7	28.8	33.6	42.8	54.4	62.9	102.2
Weight (PE 2)	p [kg/m]	20.8	20.8	23.0	25.0	34.0	39.3	51.5	64.7	74.2	119.2
Weight (PE 3)	p [kg/m]	21.0	18.6	20.8	22.7	30.5	35.5	45.6	57.7	66.6	107.8
Fire load	[kWh/m]	5.6	6.9	6.9	7.5	10.6	13.1	20.0	23.8	26.3	27.3
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	121	195	227	292	330	418	596	683	863	1042
Ambient temperature min/ MAX (daily average)	[°C]	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70

\* IP 65 for feeder lines is available on request

\*\* Class F is available on request

Data measured in accordance with IEC 61439-6

For temperatures over 50°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard version



PE 2  
Extra earth - COPPER



Extra earth - ALUMINUM  
XCP AI 3L+N+50%PE  
(available on request)

# Xtra Compact (XCP-HP)

## technical data

### XCP-HP CU (4 conductors)


3P+N+PE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Overall dimension of the busbars	L x H [mm]	125 x 130	125 x 130	125 x 130	125 x 170	125 x 170	125 x 220	125 x 380	125 x 440	125 x 480	125 x 680
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	36	50	70	70	85	120	120	150	150	150
Peak current	Ipk [kA]	76	105	154	154	187	264	264	330	330	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	1296	2500	4900	4900	7225	14400	14400	22500	22500	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the neutral bar	Ipk [kA]	45	63	88	88	112	158	158	198	198	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the protective circuit	Ipk [kA]	45	63	88	88	112	158	158	198	198	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.045	0.038	0.034	0.018	0.015	0.013	0.009	0.006	0.006
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.004
Phase impedance	Z [mΩ/m]	0.080	0.048	0.042	0.037	0.023	0.018	0.015	0.011	0.009	0.007
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.100	0.055	0.048	0.044	0.024	0.019	0.017	0.012	0.009	0.008
Phase impedance at thermal conditions	Z [mΩ/m]	0.103	0.058	0.051	0.047	0.028	0.022	0.019	0.014	0.011	0.009
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.077	0.045	0.038	0.034	0.018	0.015	0.013	0.009	0.006	0.006
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.119	0.106	0.078	0.072	0.068	0.037
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.038	0.014	0.019	0.016	0.014	0.011
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.064	0.025	0.032	0.025	0.023	0.018
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.054	0.054	0.054	0.044	0.044	0.032	0.022	0.017	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.209	0.176	0.170	0.153	0.137	0.121	0.091	0.081	0.074	0.043
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.126	0.094	0.087	0.072	0.056	0.029	0.032	0.025	0.021	0.016
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.16	0.13	0.12	0.10	0.08	0.04	0.05	0.03	0.03	0.02
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.077	0.071	0.071	0.059	0.058	0.043	0.029	0.023	0.022	0.018
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.222	0.190	0.184	0.164	0.149	0.129	0.096	0.084	0.078	0.046
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.148	0.118	0.113	0.093	0.081	0.052	0.043	0.034	0.030	0.024
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.179	0.147	0.141	0.114	0.101	0.058	0.054	0.042	0.037	0.030
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.103	0.060	0.050	0.045	0.025	0.020	0.018	0.012	0.009	0.008
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.009	0.008	0.008	0.005
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.107	0.064	0.055	0.050	0.031	0.025	0.020	0.015	0.012	0.009
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.157	0.147	0.144	0.130	0.125	0.111	0.083	0.075	0.070	0.039
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.062	0.060	0.060	0.049	0.049	0.036	0.024	0.019	0.018	0.015
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.0
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	74.9	43.9	39.4	36.1	23.3	18.5	14.8	11.1	9.0	7.1
	cosφ = 0.75	78.2	45.5	40.7	37.3	23.7	18.8	15.2	11.4	9.1	7.2
	cosφ = 0.80	81.3	47.0	41.9	38.4	24.0	19.0	15.6	11.6	9.1	7.3
	cosφ = 0.85	84.1	48.3	42.9	39.4	24.1	19.2	15.9	11.8	9.1	7.4
	cosφ = 0.90	86.7	49.3	43.6	40.1	24.1	19.1	16.1	11.8	9.0	7.4
	cosφ = 0.95	88.5	49.9	43.9	40.4	23.6	18.8	16.1	11.7	8.7	7.3
	cosφ = 1.00	86.7	47.7	41.3	38.3	20.9	16.6	14.9	10.6	7.5	6.6
Weight (PE 1)	p [kg/m]	21.2	26.9	29.6	33.5	50.4	62.2	74.2	97.9	130.3	173.6
Weight (PE 2)	p [kg/m]	24.5	30.2	32.9	37.8	54.8	73.6	83.0	108.2	141.6	189.1
Weight (PE 3)	p [kg/m]	22.3	28.0	30.7	34.9	51.8	65.9	77.1	101.5	134.2	178.7
Fire load	[kWh/m]	4.5	5.5	5.5	8	8.2	10.5	16	19	21	22
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	192	165	224	339	289	360	529	588	648	901
Ambient temperature min/ MAX (daily average)	[°C]	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70

\* IP 65 for feeder lines is available on request


\*\* Class F is available on request

Data measured in accordance with IEC 61439-6  
For temperatures over 55°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard  
version



Extra earth -  
COPPER XCP  
Cu 3L+N+50%PE  
(tinned copper conductors  
available on request)



Extra earth -  
ALUMINUM

# Xtra Compact (XCP-HP)

## technical data

### XCP-HP CU (5 conductors - clean earth)

3P+N+PE+FE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Overall dimension of the busbars	L x H [mm]	125 x 130	125 x 130	125 x 130	125 x 170	125 x 170	125 x 220	125 x 380	125 x 440	125 x 480	125 x 680
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	36	50	70	70	85	120	120	150	150	150
Peak current	Ipk [kA]	76	105	154	154	187	264	264	330	330	330
Allowable specific energy for three phase fault	I <sup>t</sup> [MA <sup>2</sup> s]	1296	2500	4900	4900	7225	14400	14400	22500	22500	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the neutral bar	Ipk [kA]	45	63	88	88	112	158	158	198	198	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the protective circuit	Ipk [kA]	45	63	88	88	112	158	158	198	198	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.045	0.038	0.034	0.018	0.015	0.013	0.009	0.006	0.006
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.004
Phase impedance	Z [mΩ/m]	0.080	0.048	0.042	0.037	0.023	0.018	0.015	0.011	0.009	0.007
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.100	0.055	0.048	0.044	0.024	0.019	0.017	0.012	0.009	0.008
Phase impedance at thermal conditions	Z [mΩ/m]	0.103	0.058	0.051	0.047	0.028	0.022	0.019	0.014	0.011	0.009
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.077	0.045	0.038	0.034	0.018	0.015	0.013	0.009	0.006	0.006
Functional Earth resistance (FE)	R <sub>20</sub> [mΩ/m]	0.077	0.045	0.038	0.034	0.018	0.015	0.013	0.009	0.006	0.006
Functional Earth reactance (FE)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.004
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.122	0.108	0.078	0.072	0.068	0.037
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.038	0.014	0.019	0.016	0.014	0.011
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.064	0.025	0.032	0.025	0.023	0.021
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.054	0.054	0.054	0.044	0.044	0.032	0.022	0.017	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.126	0.078	0.067	0.060	0.035	0.028	0.024	0.018	0.012	0.011
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.107	0.068	0.059	0.052	0.031	0.022	0.021	0.015	0.011	0.009
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.12	0.07	0.06	0.06	0.03	0.02	0.02	0.02	0.01	0.01
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.077	0.071	0.071	0.059	0.058	0.043	0.029	0.023	0.022	0.018
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.147	0.106	0.098	0.084	0.067	0.051	0.038	0.029	0.025	0.021
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.132	0.098	0.093	0.079	0.066	0.048	0.036	0.028	0.025	0.020
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.140	0.102	0.096	0.081	0.067	0.049	0.037	0.028	0.025	0.021
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.103	0.060	0.050	0.045	0.025	0.020	0.018	0.012	0.009	0.008
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.009	0.008	0.008	0.005
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.107	0.064	0.055	0.050	0.031	0.025	0.020	0.015	0.012	0.009
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.103	0.060	0.050	0.045	0.025	0.020	0.018	0.012	0.009	0.008
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.031	0.023	0.023	0.020	0.019	0.015	0.009	0.008	0.008	0.005
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.107	0.064	0.055	0.050	0.031	0.025	0.020	0.015	0.012	0.009
Voltage drop with distributed load $\Delta V [V/(m^2A)] \cdot 10^{-6}$											
$\cos\phi = 0.70$											
74.9											
$\cos\phi = 0.75$											
78.2											
$\cos\phi = 0.80$											
81.3											
$\cos\phi = 0.85$											
84.1											
$\cos\phi = 0.90$											
86.7											
$\cos\phi = 0.95$											
88.5											
$\cos\phi = 1.00$											
86.7											
Weight (PE 1)	p [kg/m]	23.8	31.1	34.5	39.0	59.9	74.3	88.2	117.3	157.4	200.3
Weight (PE 2)	p [kg/m]	27.2	34.5	37.8	43.4	64.3	85.6	96.9	127.6	168.8	215.7
Weight (PE 3)	p [kg/m]	24.9	32.2	35.5	40.4	61.3	78.0	91.1	120.8	161.4	204.5
Fire load	[kWh/m]	5.625	6.875	6.875	10	10.25	13.125	20	23.75	26.25	27.25
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	192	165	224	339	289	360	529	588	648	901
Ambient temperature min/ MAX (daily average)	[°C]	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70


\* IP 65 for feeder lines is available on request

\*\* Class F is available on request


Data measured in accordance with IEC 61439-6

For temperatures over 55°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020


The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



PE 1  
Standard version



PE 2  
Extra earth - COPPER XCP Cu 3L+N+50%PE (tinned copper conductors available on request)



PE 3  
Extra earth - ALUMINUM

# Xtra Compact (XCP-HP)

## technical data

### XCP-HP CU (5 conductors - double neutral)




3P+2N+PE	In [A]	SINGLE BAR						DOUBLE BAR			TRIPLE BAR
Rated current		800	1000	1250	1600	2000	2500	3200	4000	5000	6300
Overall dimension of the busbars	L x H [mm]	125 x 130	125 x 130	125 x 130	125 x 170	125 x 170	125 x 220	125 x 380	125 x 440	125 x 480	125 x 680
Rated operational voltage	Ue [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Rated insulation voltage	Ui [V]	1000	1000	1000	1000	1000	1000	1000	1000	1000	1000
Frequency	f [Hz]	50	50	50	50	50	50	50	50	50	50
Rated short-time current (1 s)	Icw [kA]rms	36	50	70	70	85	120	120	150	150	150
Peak current	Ipk [kA]	76	105	154	154	187	264	264	330	330	330
Allowable specific energy for three phase fault	I <sup>2</sup> t [MA <sup>2</sup> s]	1296	2500	4900	4900	7225	14400	14400	22500	22500	22500
Rated short-time current of the neutral bar (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the neutral bar	Ipk [kA]	45	63	88	88	112	158	158	198	198	198
Rated short-time current of the protective circuit (1 s)	Icw [kA]rms	22	30	42	42	51	72	72	90	90	90
Peak current of the protective circuit	Ipk [kA]	22	63	88	88	112	158	158	198	198	198
Phase resistance at 20°C	R <sub>20</sub> [mΩ/m]	0.077	0.045	0.038	0.034	0.018	0.015	0.013	0.009	0.006	0.006
Phase reactance (50Hz)	X [mΩ/m]	0.023	0.017	0.017	0.015	0.014	0.011	0.007	0.006	0.006	0.004
Phase impedance	Z [mΩ/m]	0.080	0.048	0.042	0.037	0.023	0.018	0.015	0.011	0.009	0.007
Phase resistance at thermal conditions	R <sub>t</sub> [mΩ/m]	0.100	0.055	0.048	0.044	0.024	0.019	0.017	0.012	0.009	0.008
Phase impedance at thermal conditions	Z [mΩ/m]	0.103	0.058	0.051	0.047	0.028	0.022	0.019	0.014	0.011	0.009
Neutral resistance	R <sub>20</sub> [mΩ/m]	0.038	0.022	0.019	0.017	0.009	0.007	0.007	0.005	0.003	0.003
Resistance of the protective bar (PE 1)	R <sub>PE</sub> [mΩ/m]	0.132	0.132	0.132	0.119	0.122	0.108	0.078	0.072	0.068	0.037
Resistance of the protective bar (PE 2)	R <sub>PE</sub> [mΩ/m]	0.049	0.049	0.049	0.038	0.038	0.014	0.019	0.016	0.014	0.011
Resistance of the protective bar (PE 3)	R <sub>PE</sub> [mΩ/m]	0.084	0.084	0.084	0.064	0.064	0.025	0.032	0.025	0.023	0.021
Reactance of the protective bar	X <sub>PE</sub> [mΩ/m]	0.054	0.054	0.054	0.044	0.044	0.032	0.022	0.017	0.016	0.014
Resistance of the fault loop (PE 1)	R <sub>o</sub> [mΩ/m]	0.209	0.176	0.170	0.153	0.140	0.123	0.091	0.081	0.075	0.043
Resistance of the fault loop (PE 2)	R <sub>o</sub> [mΩ/m]	0.126	0.094	0.087	0.072	0.056	0.029	0.032	0.025	0.021	0.016
Resistance of the fault loop (PE 3)	R <sub>o</sub> [mΩ/m]	0.16	0.13	0.12	0.10	0.08	0.04	0.05	0.03	0.03	0.03
Reactance of the fault loop (50Hz)	X <sub>o</sub> [mΩ/m]	0.077	0.071	0.071	0.059	0.058	0.043	0.029	0.023	0.022	0.018
Impedance of the fault loop (PE 1)	Z <sub>o</sub> [mΩ/m]	0.222	0.190	0.184	0.164	0.152	0.130	0.096	0.084	0.078	0.047
Impedance of the fault loop (PE 2)	Z <sub>o</sub> [mΩ/m]	0.148	0.118	0.113	0.093	0.081	0.052	0.043	0.034	0.030	0.024
Impedance of the fault loop (PE 3)	Z <sub>o</sub> [mΩ/m]	0.179	0.147	0.141	0.114	0.101	0.058	0.054	0.042	0.037	0.032
Zero-sequence short circuit average resistance phase - N	R <sub>o</sub> [mΩ/m]	0.064	0.037	0.032	0.028	0.015	0.012	0.011	0.008	0.005	0.005
Zero-sequence short circuit average reactance phase - N	X <sub>o</sub> [mΩ/m]	0.019	0.014	0.014	0.013	0.012	0.009	0.006	0.005	0.005	0.003
Zero-sequence short circuit average impedance phase - N	Z <sub>o</sub> [mΩ/m]	0.067	0.040	0.035	0.031	0.019	0.015	0.012	0.009	0.007	0.006
Zero-sequence short circuit average resistance phase - PE	R <sub>o</sub> [mΩ/m]	0.157	0.147	0.144	0.130	0.125	0.111	0.083	0.075	0.070	0.039
Zero-sequence short circuit average reactance phase - PE	X <sub>o</sub> [mΩ/m]	0.062	0.060	0.060	0.049	0.049	0.036	0.024	0.019	0.018	0.015
Zero-sequence short circuit average impedance phase - PE	Z <sub>o</sub> [mΩ/m]	0.169	0.158	0.156	0.139	0.134	0.117	0.086	0.077	0.072	0.042
Voltage drop with distributed load ΔV [V/(m <sup>2</sup> A)]10 <sup>-6</sup>	cosφ = 0.70	74.9	43.9	39.4	36.1	23.3	18.5	14.8	11.1	9.0	7.1
	cosφ = 0.75	78.2	45.5	40.7	37.3	23.7	18.8	15.2	11.4	9.1	7.2
	cosφ = 0.80	81.3	47.0	41.9	38.4	24.0	19.0	15.6	11.6	9.1	7.3
	cosφ = 0.85	84.1	48.3	42.9	39.4	24.1	19.2	15.9	11.8	9.1	7.4
	cosφ = 0.90	86.7	49.3	43.6	40.1	24.1	19.1	16.1	11.8	9.0	7.4
	cosφ = 0.95	88.5	49.9	43.9	40.4	23.6	18.8	16.1	11.7	8.7	7.3
	cosφ = 1.00	86.7	47.7	41.3	38.3	20.9	16.6	14.9	10.6	7.5	6.6
Weight (PE 1)	p [kg/m]	23.8	31.1	34.5	39.0	59.9	74.3	88.2	117.3	157.4	200.3
Weight (PE 2)	p [kg/m]	27.2	34.5	37.8	43.4	64.3	85.6	96.9	127.6	168.8	215.7
Weight (PE 3)	p [kg/m]	24.9	32.2	35.5	40.4	61.3	78.0	91.1	120.8	161.4	204.5
Fire load	[kWh/m]	5.625	6.875	6.875	10	10.25	13.125	20	23.75	26.25	27.25
Degree of protection	IP	55*	55*	55*	55*	55*	55*	55*	55*	55*	55*
Insulation material thermal resistance class		B**	B**	B**	B**	B**	B**	B**	B**	B**	B**
Losses for the Joule effect at nominal current	P [W/m]	192	165	224	339	289	360	529	588	648	901
Ambient temperature min/ MAX (daily average)	[°C]	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70	-5/+70

\* IP 65 for feeder lines is available on request

\*\* Class F is available on request

Data measured in accordance with IEC 61439-6  
For temperatures over 55°C it will be necessary to derate the busbar and for ambient temperatures under -5°C please contact technical support on +44 (0) 370 608 9020

The data on this page refers to the 50 Hz frequency. For 60 Hz please contact technical support on +44 (0) 370 608 9020



## Xtra Compact (XCP)

design instructions for the creation of a rising mains (BTS\*)

- 1) The RH rising main feed unit (without monobloc) is used at the start of the riser line, allowing the busbar to be installed just 40 mm away from the wall  
In order to position the tap-off boxes correctly as shown in the figure (see opposite), the neutral conductor of the riser main must be on the left side of the length
- 2) The tap-off boxes can be installed in the tap-off outlets (Plug-in type) and on the junction of elements (Bolt-on type)  
The cables come out from bottom part of the tap-off boxes
- 3) Use lengths with tap-off outlets where it is necessary to draw energy through plug-in boxes
- 4) EI120 fire barrier kit for each compartment floor, where requested  
Note : the fire barrier is long 630 mm with aluminum conductors and 1000 mm with copper conductors
- 5) Position the IP 55 end cover at the end of the riser mains


### Maximum hanging distance with springs (Dmax)

In (A)	XCP-S				XCP-HP			
	D max	Al n° of springs	Cu D max	Cu n° of springs	D max	Al n° of springs	D max	Cu n° of springs
630	11	4	-	-	10	4	-	-
800	10	4	9	4	10	4	9	4
1000	10	4	8	4	9	4	7	4
1250	9	4	7	4	9	4	7	4
1600	10	6	6	4	10	6	6	4
2000	9	6	6	6	9	6	4	4
2500	12	8	9	8	11	8	5	6
3200	11	12	7	8	11	12	6	8
4000	10	12	7	12	10	12	6	12
5000	7	12	5	12	6	12	5	12
6300	-	-	4	12	-	-	4	12

For 5C version, multiply Dmax by 0.9 for both product lines

For 3C version, multiply Dmax by 1.1 for both product lines

### Spring preload calculation (H)

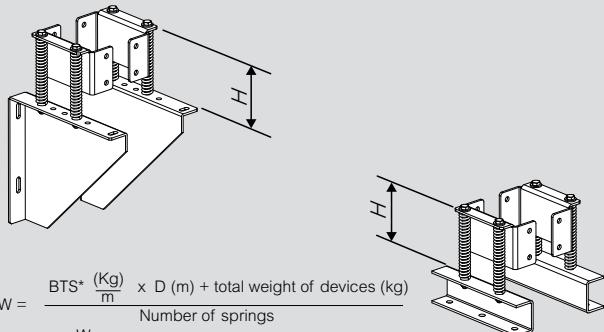

$$W = \frac{\text{BTS}^* (\text{Kg})}{\text{m}} \times D (\text{m}) + \text{total weight of devices (kg)} \quad \text{Number of springs}$$

$$H = 130 - \frac{W}{3}$$

### Preload calculation example (H)

BTS\* type : XCP-S 5c-Al (PE1)

In (A) : 2000

Dmax (m) :  $9 \times 0.9 = 8.1$

D (m) : 6


Busway (Kg/m) : 31.1

Weight box 1 (Kg) : 18

Weight box 2 (Kg) : 12

$$W = \frac{31.1 \times 6 + (18 + 12)}{6} = 36.1 \text{ kg} \quad H = 130 - \frac{36.1}{3} = 117.97 \text{ mm}$$

\* BTS = busway trunking system

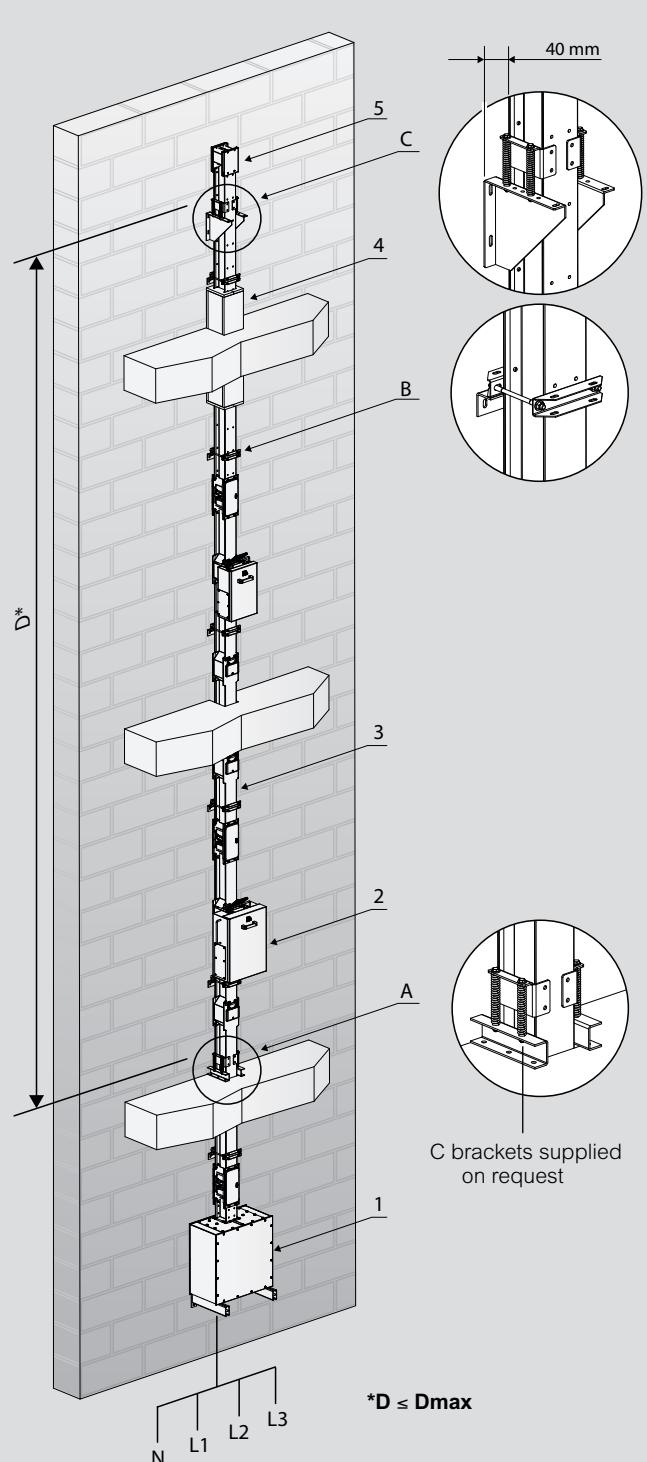

**A) Floor hanger :** use one or more of these suspension brackets, depending on the weight of the whole riser mains (including the boxes)

For risers that are shorter than 4 m, fix to the base with type D brackets, when longer, use type C suspension brackets respecting the maximum distances (Dmax) indicated in the tables

**B) Standard hanger :** use this type of suspension bracket to hang the busbar every 1.5 metres of the riser mains


**C) Wall hanger :** use one or more of these suspension brackets, depending on the weight of the whole riser mains (including the boxes)

For risers that are shorter than 4 m, fix to the base with type B brackets, when longer, use a type A suspension bracket respecting the maximum distances (Dmax) indicated in the tables

# Xtra Compact (XCP)


## technical information

### The system : the Legrand transformer advantage

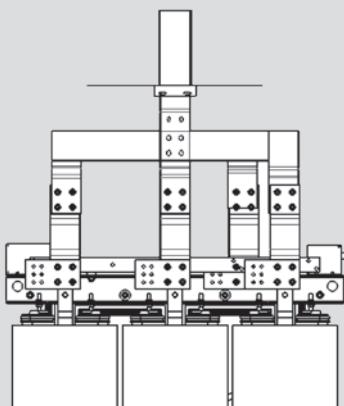

Zucchini cast resin transformers from Legrand

### The system : connection to LV switchboard

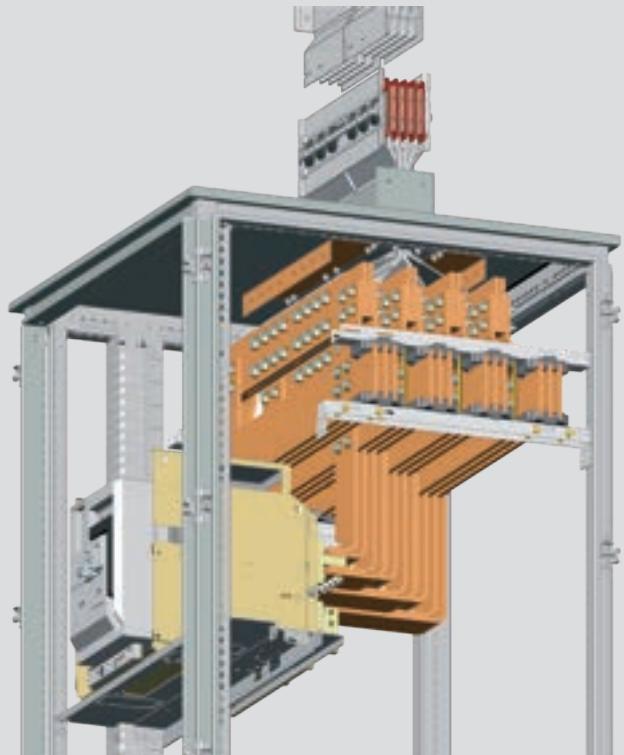

The Legrand Group product synergy answers to global installation needs

Legrand cast resin transformers have specifically designed connections for Legrand busbars

The versions shown represent some of the standardised solutions

For more information, contact us on +44 (0) 370 608 9020

A background image showing architectural blueprints of a building layout, a yellow tape measure, and an orange hard hat.

# OPERATING INFORMATION

Suggestions for the  
design and installation  
of the busbar

Operational information and advice for the  
correct design and construction of the busbar  
trunking system

## Xtra Compact (XCP)

#### **suggestions for the project development**

**1. Rating**  
**2500** A

**2. Application :**

Transport

Distribution  No. of outlets .....

**3. Icc at the beginning of the line** .....kA

**4. Material :**

Aluminium

Copper

**5. Degree of protection :**

IP 55 (standard)

IP 65 (only for transport of Energy)

**6. Paint :**

RAL7035 (standard)

Different RAL  
colour on request .....

**7. Neutral section :**

100% XCP (standard)

200% XCP 2N

**8. Nominal ambient temperature :**


35°C (standard)

Other on request.....

## 9. Attach Busbar layout\*

- Drawing
  - Dwg file
  - Revit file

\* Example of drawing to attach

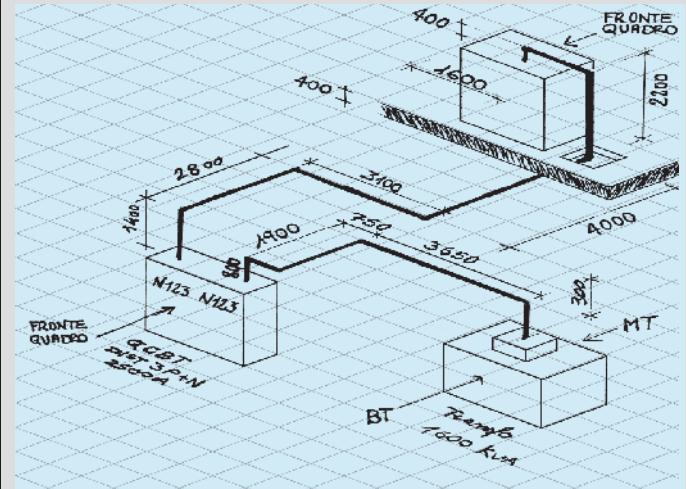

# Xtra Compact (XCP)


suggestions for the project development

## Example for quotation check list :

### Checklist to be carried out during the project

1. Verify the measurements of the drawings and the correct position of the equipment (MV/LV transformer and LV electric board enclosures)
2. Check the availability of drawings required (transformer, electric board, etc.)
3. Check for the existence of unforeseen obstacles in the installation which could impede the run of the busbar (for example pipelines, ventilation and air-conditioning ducts)
4. Agree upon who is responsible for providing the connection from the busbar to the other devices (MV/LV transformer and LV electric boards)

### Example of the detail of the project

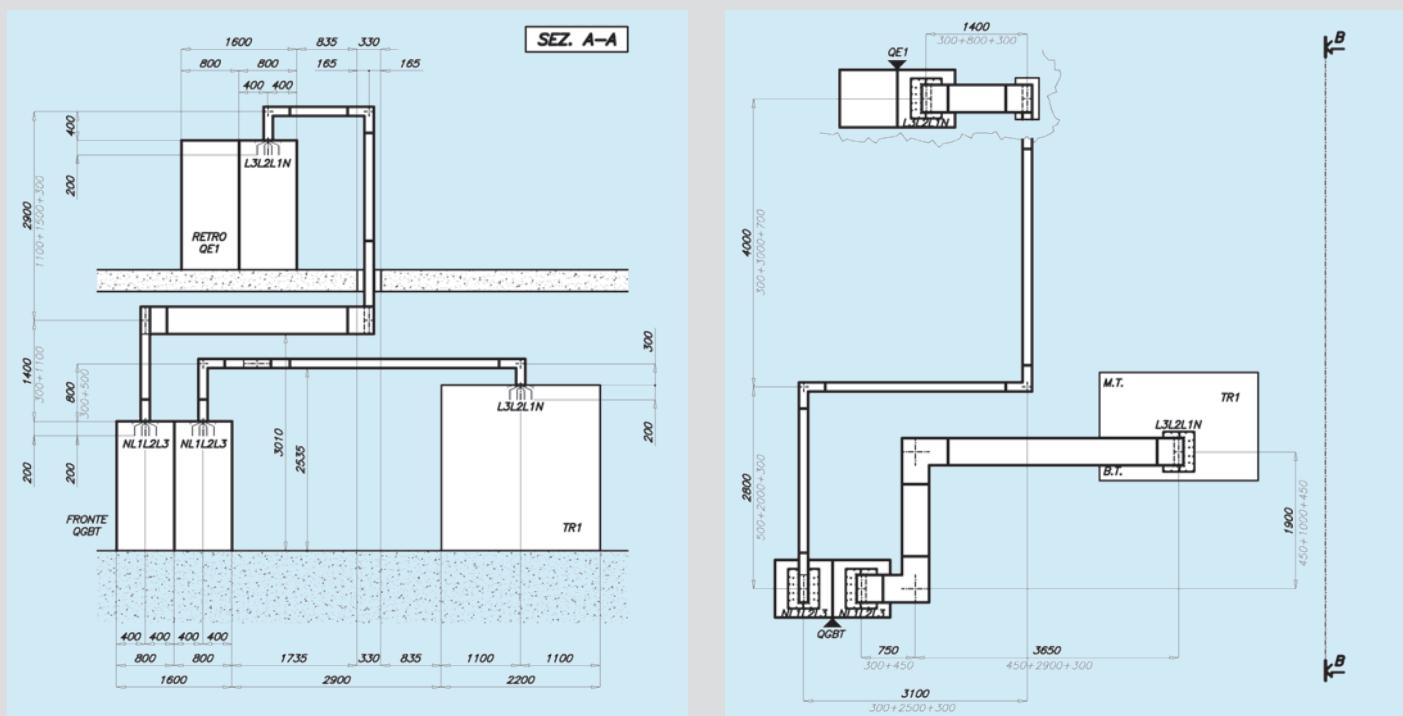


### If required, Legrand can provide :

- The mechanical layout of the project
- Study of the connections between the busbar and the transformer or between electric board enclosures
- Possibility of site measurement by qualified persons

# Xtra Compact (XCP)

## installation guidelines


### ■ Installation sequence of the junction

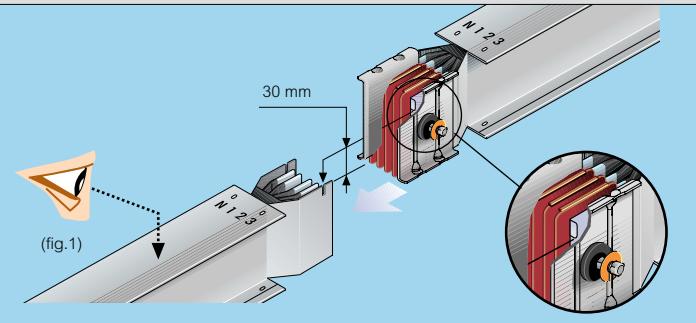

The installation instructions are placed on every element near the junction

Make sure that the contacts are clean


Join the two elements together (Fig.1)

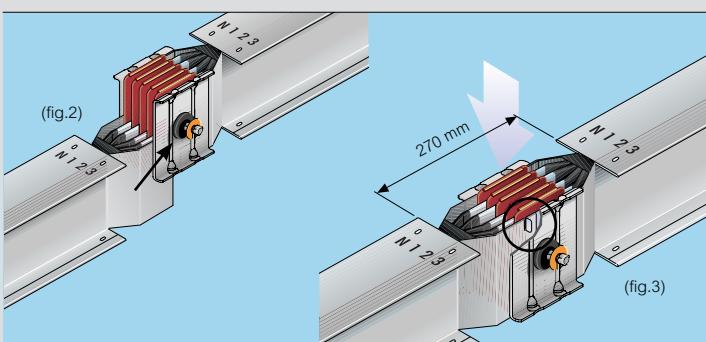

Make sure that the earth plate of the straight length is inserted behind the front plate of the junction monobloc (Fig.2)

The positioning pin on the monobloc should be fitted into the corresponding slot on the earth plate

Verify that the distance between the elements is 270 mm before tightening the monobloc completely (Fig.3)


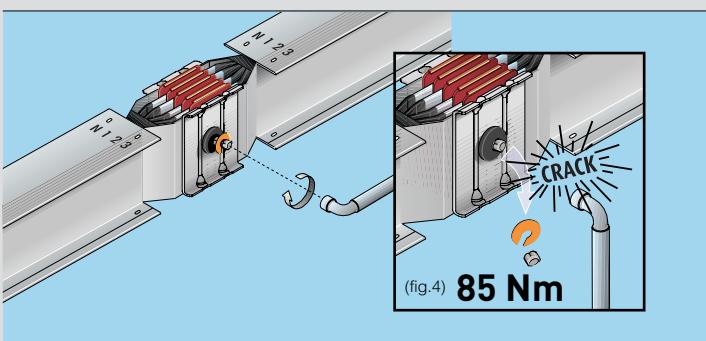


Tighten the bolt of the monobloc until the 1st head breaks off (Fig. 4)

The bolt that tightens the monobloc has a second head which is used when carrying out operations or inspections on the line

The nominal tightening torque is 85 Nm

**In standard execution,  
the self-shearing bolt is  
fitted on the opposite  
side of the neutral**

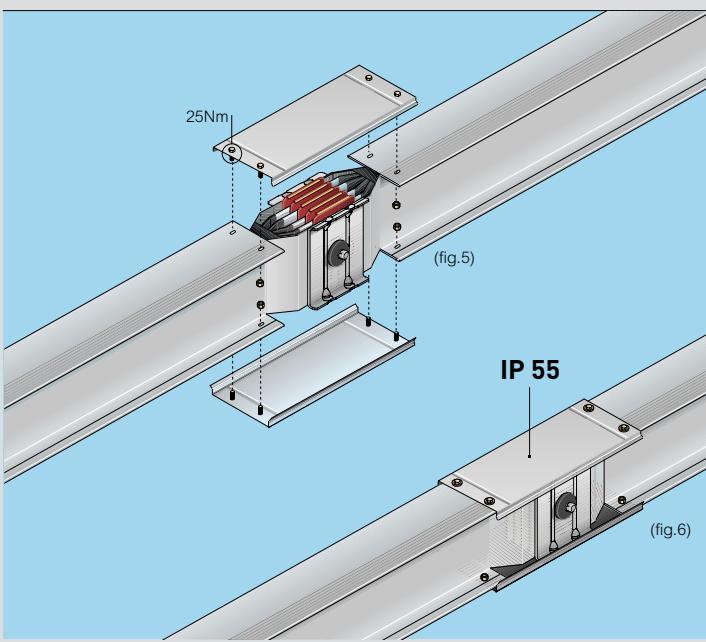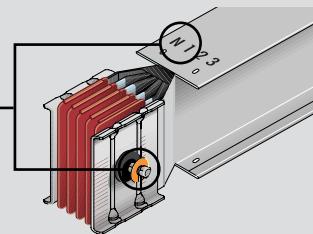

Install the covers of the junction (fig. 5)

Connection completed correctly with protection degree IP 55 (fig.6)

## Xtra Compact (XCP)

### mechanical design precautions

Below are some precautions that may be useful to avoid problems during the assembly, which we recommend should be taken into account during the design




#### ■ Minimum distances from the structure

The minimum distance from the walls in order to avoid problems during edgeway installation of the busbar is 300 mm  
The variables that must be taken into account for correct assembly are :



- the position of the bolt for tightening the monobloc. The minimum required distance is 100 mm
- the sizes of the distribution element (box) selected for the collection of power should be at least 300 mm
- any brackets and their assembly
- accessibility to the screws for the installation of the brackets and the closing of the junctions
- any material required for the actual installation in order to compensate for any wall imperfections

In projects with a rising main installation, and if the system does not require fire barriers, the fixing supporting the bracket can be directly secured to the wall. Otherwise, allow for a spacing support between the bracket and the wall to ensure that the back of the busbar remains at a distance of 100 mm from the wall, therefore ensuring enough space for the positioning of the partitions



#### Minimum distance of the wall / ceiling elements

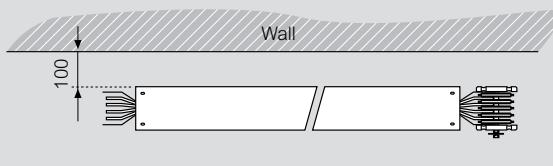



**When there are tap-off units along the busbars, the minimum distances depend on the dimensions of the tap-offs selected**

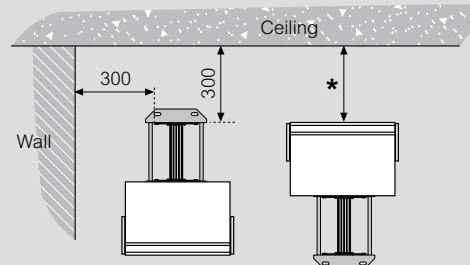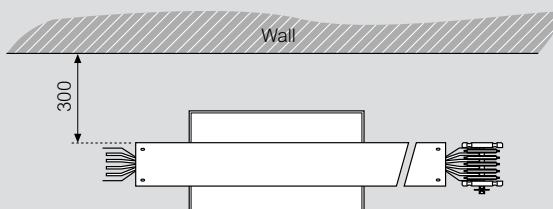

\* When there is a tap-off box installed above the busbar, check the overall dimensions of the open cover of the tap-off unit used in the specific section

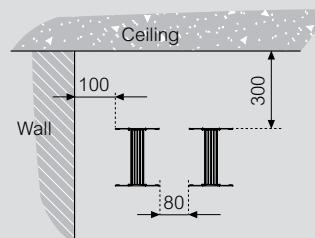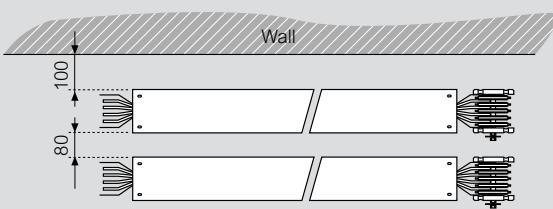

Minimum installation distance when there are several adjacent lines

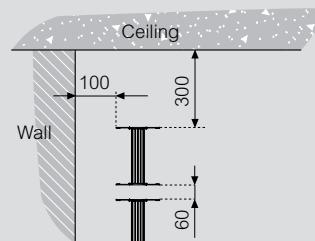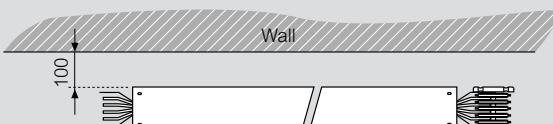

Minimum installation distance when there are several overlapped lines

# Xtra Compact (XCP)



## mechanical design precautions

### Positioning of the mechanical joint arrangement

The minimum distance from the junction to the point the busbar crosses the wall or other structure must be at least 200 mm, to ensure the closure of the junctions


Where plug-in boxes and fire barriers are required on the same element, the minimum distance between the box and the partition must be taken into account, at the same time allowing for the necessary free space in the junction area and the minimum distance between the distribution outlet and the start of the element

By taking all these variables into account, it is possible to obtain the minimum size of the element in order to fit the partition and the plug-in box. The tables that follow summarise the minimum sizes

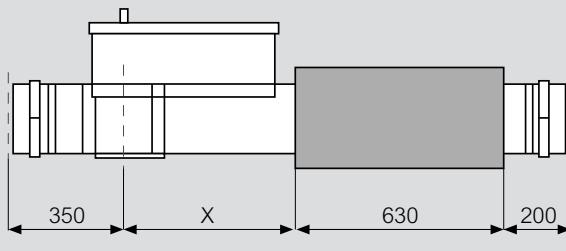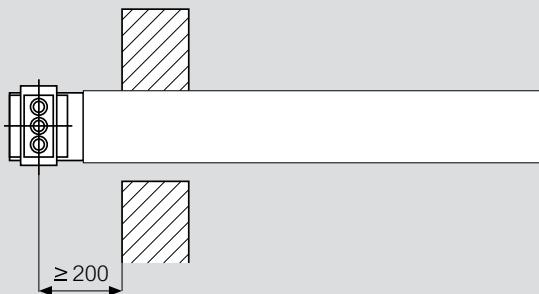

Refers to aluminium

PLUG-IN TAP-OFF BOXES (X MINIMUM SIZE)		
Type	Rating (A)	X (mm)
1	63 – 160	520
2	250 – 630	720
3	125 – 400	620

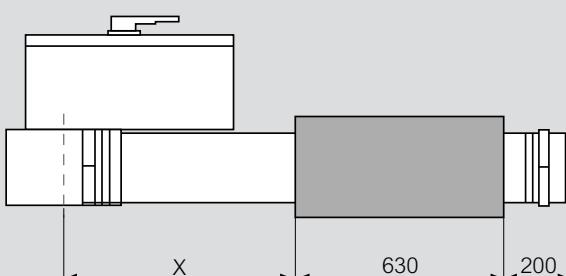

Refers to aluminium

PLUG-IN BOXES ON THE JUNCTION		
Type	Rating (A)	X (mm)
-	125 – 400	700
-	630	820
-	800 – 1250	1120

### Connection to the board

As a rule, the manufacturer of the board is responsible for connecting the connection element and the distribution busbars inside the board

On request Legrand may develop and supply the connections, subject to all necessary details being available

All types of connections must be agreed and checked with the board manufacturer

### Short circuit withstand


The short circuit withstand of the connection elements depends on the connection of the busbars inside the distribution board

The declaration of short circuit withstand for the system busbars may only be supplied by the board manufacturer

## Xtra Compact (XCP)

measurement of straight length and special path elements

### Measurement of straight lengths

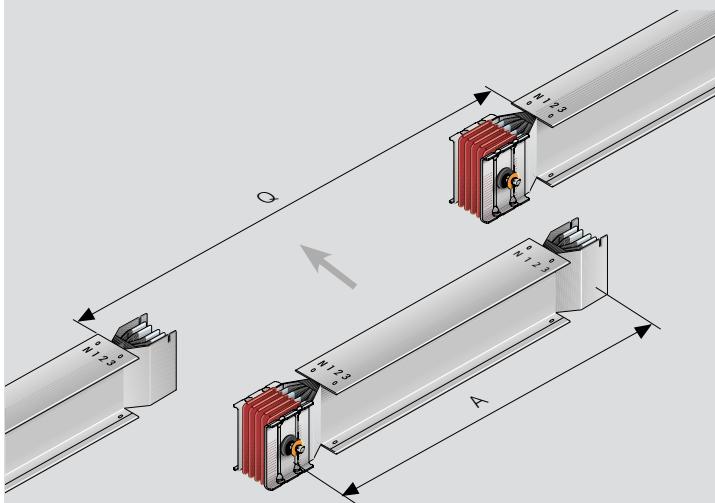


The exact length of the piece to be ordered can be determined by measuring the distance between the lengths (as shown in the picture) and then subtracting 270 mm from the dimension that has been taken

$$A \text{ (Length of element)} = Q - 270 \text{ mm}$$

Example : Dimension measuring Q = 2500 mm  
Order element (2500 - 270) = 2230 mm (quote A)

### Measurement for ordering a special path element

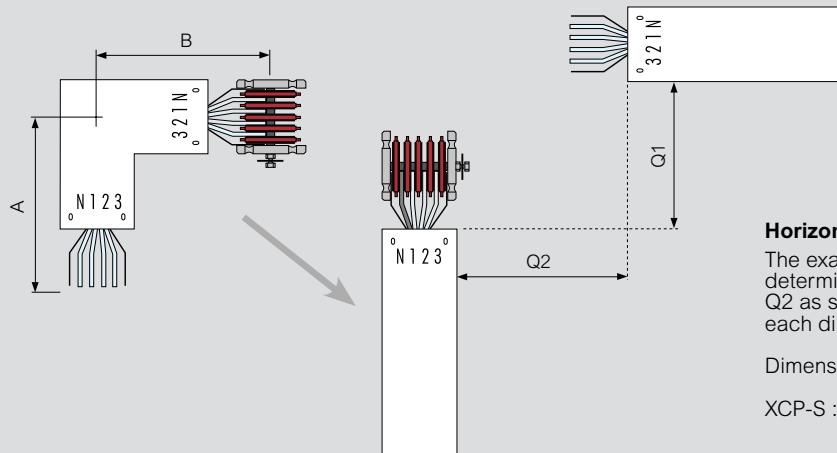

#### Horizontal elbow

The exact length of the piece to be ordered can be determined by measuring the dimensions Q1 and Q2 as shown opposite and then by subtracting from each dimension the values indicated below

Dimensions of the element to be ordered:

XCP-S : **A** = Q1 - 75 mm  
**B** = Q2 - 75 mm

XCP-HP : **A** = Q1 - 72.5 mm  
**B** = Q2 - 72.5 mm


# Xtra Compact (XCP)

## Insulation technology

### Superior moisture-free insulation technology


XCP busbars are insulated by a PET\* film wrapping. To get superior quality and safety, conductor bars are wrapped with two sheets, both of which are enough to ensure the complete dielectric level required. Therefore, the second sheet has the function to double insulate and ensure the safety of the bar in the chance of remote failure of the first sheet. The PET\* films used to insulate the bars are non-hygroscopic and therefore their dielectric performance is independent to the air humidity. XCP construction follows a sandwich logic. In this way, free air circulation is not possible inside the casing. Thanks to this IP rating, penetration of humidity and dust is prevented (IP 55 or IP 65 on request), regardless of the orientation of the busbar elements. In any case, an energised bar has a temperature higher in comparison to the surrounding atmosphere, and this prevents any possibility of condensation or eventual moisture, an event that can only happen on colder surfaces. Thanks to the double insulating layer technology, together with the sandwich construction, the XCP range is fully protected from any problems that can occur from humidity.

### Fully enclosed housing

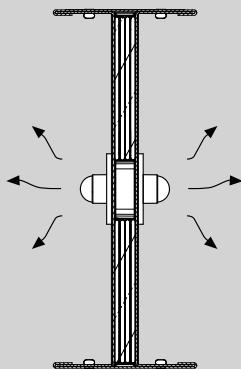

The XCP BTS\*\* has a modern fully enclosed housing design that does not need derating whatever the mounting position. Due to the fact that there are no ventilation holes in the housing, the possibility for dirt and moisture to enter into contact with bars is extremely low.

PET\* based insulation technology is sometimes incorrectly associated with a reduction in performance due to atmospheric humidity. This is a misperception. PET\* itself is not hygroscopic and therefore its performance is not affected by any moisture entity. The area that could be affected is the layer of air found between the conductive bar and the PET\* film. However this layer is negligible and the XCP design uses these air layers to increase the insulation level to more than double the requirement. Consequently, the total isolation level provided by the XCP range is even higher than that provided by the double PET\* film.

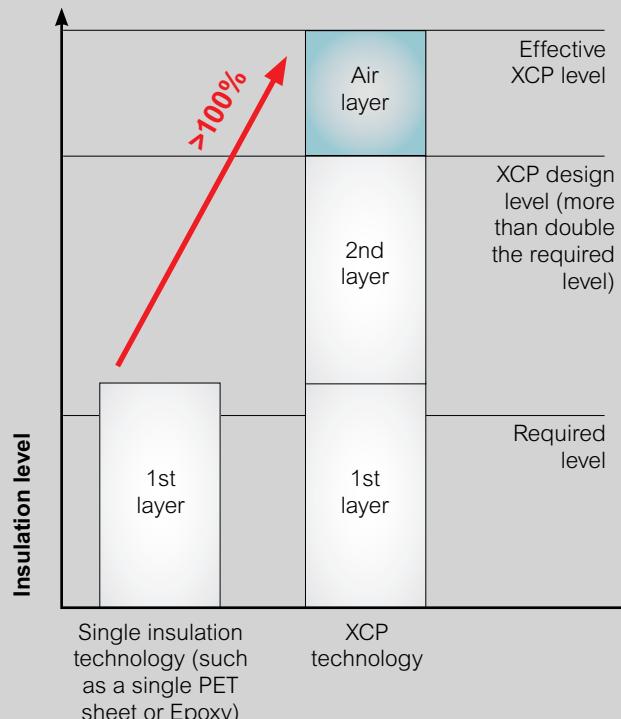

\*PET = polyethylene terephthalate  
the most useful insulation material for the electric and electronics industry, PET is used for example in the windings of transformers and to insulate the rotor and stators of electric motors

\*\* BTS = busway trunking system

# IP 68 RCP RESIN busbar trunking



## RCP resin busbar - suitable for indoor and outdoor installations



With an ingress protection rating of IP 68 and ranging from 630 A to 6300 A, RCP is ideal for the distribution of high power energy in external environments.

RCP is manufactured with either aluminium or copper conductors which are completely embedded

in an epoxy resin, that provides mechanical strength and electrical insulation.

RCP resin busbar has good performance in fire conditions and exceeds the requirements stipulated in IEC 60331-1 : 2009 for continuity of service in the event of fire.



## Green T.HE high efficiency transformers

### quality through to the core

From July 2021, regulation 548/2014 (updated by regulation 2019/1783) requires manufacturers to reduce no-load losses of their transformers by 10% compared with the previous requirement.

Legrand's Zucchini Green T.HE (Tier 2) transformers fully comply with the new eco-compatible design rules and guarantee a significant reduction in energy consumption, thus promoting substantial economic savings and the reduction of CO<sub>2</sub> emissions into the atmosphere.



To find out more call our technical support team on  
+44 (0) 370 608 9020

## Protection classifications

### Protection against solid bodies and liquids : Index of protection - IP xx

Degree of protection of enclosures of electrical equipment in accordance with standards  
IEC 60529, BS EN 60529  
Up to 1 000 V~ and 1 500 V=

1 <sup>st</sup> digit: protection against solid bodies		Additional letter IP XX (ABCD): protection against direct contact resulting from the access to hazardous current-carrying parts			2 <sup>nd</sup> digit: protection against liquids	
IP	tests	IP	tests	protection		
<b>0</b>	No protection				<b>0</b>	No protection
<b>1</b>	Ø 50 mm Protected against solid bodies larger than 50 mm	A	Ø 50 mm 	The back of the hand remains remote from dangerous parts	<b>1</b>	Protected against vertically-falling drops of water (condensation)
<b>2</b>	Ø 12.5 mm Protected against solid bodies larger than 12.5 mm	B	12 mm 	The dangerous parts can not be touched when introducing a finger	<b>2</b>	Protected against drops of water falling at up to 15° from the vertical
<b>3</b>	Ø 2.5 mm Protected against solid bodies larger than 2.5 mm	C		The dangerous parts can not be touched when introducing a tool (e.g. a screwdriver)	<b>3</b>	Protected against drops of rain water at up to 60° from the vertical
<b>4</b>	Ø 1 mm Protected against solid bodies larger than 1 mm	D		The dangerous parts cannot be touched when introducing a wire	<b>4</b>	Protected against projections of water from all directions
<b>5</b>	Protected against dust (no harmful deposit)				<b>5</b>	Protected against jets of water from all directions
<b>6</b>	Completely protected against dust				<b>6</b>	Protected against jets of water of similar force to heavy seas
					<b>7</b>	Protected against the effects of immersion
					<b>8</b>	Protected against prolonged effects of immersion under pressure
					<b>9K1</b>	Protected against high pressure and temperature water jets

Legrand appliances for domestic applications, once installed, have a degree of protection IP equal to or greater than IP 2XC  
1 : in accordance to ISO 20653

### Protection against mechanical impact : Index of protection - IK

According to standards IEC 62262 and BS EN 62262

IK	Tests	Impact energy (in Joules)
IK 00		0
IK 01		0.15
IK 02		0.2
IK 03		0.35
IK 04		0.5
IK 05		0.7
IK 06		1
IK 07		2
IK 08		5
IK 09		10
IK 10		20

A product previously classed as IP xx-7 can be assumed to fulfill the conditions of an IP xx - IK 08

This table can be used to ascertain the resistance of a product to an impact given in Joules from the IK code (graduated from 00 to 10). It can also be used to ascertain the correspondence with the old IP code 3rd digit and the corresponding external "Ag" conditions.

The contents of the Protection Classifications charts are for guidance only. If you have any doubt as to the interpretation of the information contained therein, please refer either to the standard itself or contact Legrand.

## Health and Safety at Work, etc. Act. 1974

### Statement to Purchasers and Prospective Purchasers

1. Section 6 of this Act provides that manufacturers, designers, importers or suppliers of articles for use at work have a duty to ensure so far as is reasonably practical, that the article will be safe and without risk to health when properly used. An article is not regarded as being 'properly used' if it is used without regard to any relevant information or advice relating to its use made available by the manufacturer, designer, importer or supplier.

2. With regard to these provisions the following is given as a guide to the information which is readily available to you. This information relates to those products detailed in our catalogue(s) or associated literature or may be obtained by specific request to the Company.

3. All products should be installed and maintained in accordance with good engineering practice and relevant British or

other applicable standards, regulations for the installation of equipment by the Institute of Electrical Engineers or any other applicable Codes of Practice.

### Health and Safety at Work Act

### The Electricity at Work Regulations, 1989

- All installations and maintenance should be carried out within the provision of the above Act and by persons so qualified as defined in the Act.
- Information and advice on the suitability of our products can be obtained from Legrand Electric Limited on specific request.

For information concerning wiring device standards outside the UK contact :

BSI

Customer Services

09:00 to 17:00 – Monday to Friday

Tel : +44 (0) 20 8996 9001

Fax : +44 (0) 20 8996 7001

Email : cservices@bsi-global.com



marking appears on electrical or electronic products from Legrand and enables the circulation of goods outside the UK.

**Conditions of sale**  
Please consult our current price list

In accordance with its policy of continuous improvement the Company reserves the right to change specifications and designs without notice.  
All illustrations, descriptions, dimensions and weights in this catalogue are for guidance and cannot be held binding on the Company.


## Contact details

### Quotations and Technical Support:

Legrand Electric Ltd.  
Great King Street North,  
Birmingham, B19 2LF  
Tel: +44 (0) 370 608 9020  
E-mail: powersales.uk@legrand.co.uk

### Customer Services:

Tel: +44 (0) 345 605 4333  
E-mail: powersales.uk@legrand.co.uk

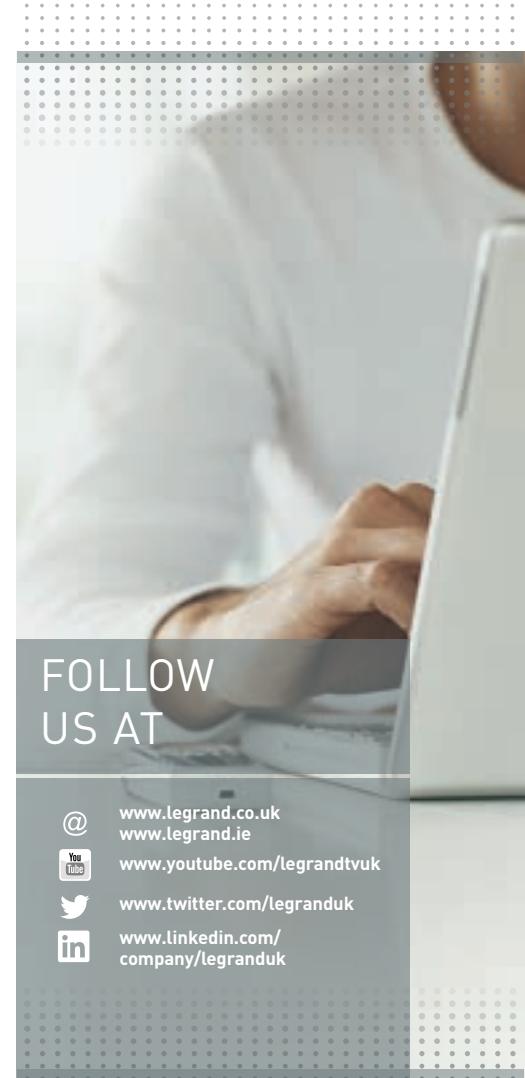

FOLLOW  
US AT



[www.legrand.co.uk](mailto:www.legrand.co.uk)  
[www.legrand.ie](mailto:www.legrand.ie)



[www.youtube.com/legrandtvuk](http://www.youtube.com/legrandtvuk)



[www.twitter.com/legranduk](http://www.twitter.com/legranduk)



[www.linkedin.com/  
company/legranduk](http://www.linkedin.com/company/legranduk)



### Head office (UK and Ireland):

Legrand Electric Limited  
Great King Street North, Birmingham, B19 2LF  
Tel: +44 (0) 370 608 9000  
Website: [www.legrand.co.uk](http://www.legrand.co.uk)

In accordance with its policy of continuous improvement, the Company reserves the right to change specifications and designs without notice. All illustrations, descriptions, dimensions and weights in this catalogue are for guidance and cannot be held binding on the Company. All contents and design presentation included in this publication are © Legrand Electric Limited. All rights reserved. 2023



This document is printed on sustainably sourced paper. Please recycle.

The Legrand logo is a registered trademark of the Legrand group of companies.